
ATTACHMENT A

and the state of the

OPERATIONS AND MAINTENANCE MASTER PLAN FOR AQUIFER RESTORATION AND WASTEWATER TREATMENT

OPERATIONS AND MAINTENANCE MASTER PLAN FOR AQUIFER RESTORATION AND WASTEWATER TREATMENT

FERNALD CLOSURE PROJECT



JUNE 2006

U.S. DEPARTMENT OF ENERGY

2505-OM-001 Final, Revision 4

OPERATIONS AND MAINTENANCE MASTER PLAN FOR AQUIFER RESTORATION AND WASTEWATER TREATMENT

FERNALD CLOSURE PROJECT

JUNE 2006

U.S. DEPARTMENT OF ENERGY

Final, Revision 4

TABLE OF CONTENTS

	<u>Page</u>				
List of Acronyms	v				
List of Figures					
List of Tablesi	V				
1.0 Introduction	1-1				
1.1 Scope of ARWWT and Objectives of OMMP	1-1				
1.2 Basis and Need	1-2				
1.3 Relationship to Other Documents	1-4				
1.4 Plan Organization	1-5				
1.5 Program Modifications and Revisions	1-6				
2.0 Summary of Regulatory Drivers and Commitments	2-1				
2.1. Discharge Limits	2-1				
2.1.1 Operable Unit 5 Record of Decision	2-1				
2.1.2 NPDES Permit	2-2				
2.2 Source Water Treatment Requirements	2-2				
2.2.1 Groundwater	2-2				
2.2.2 Storm Water	2-2				
2.2.3 OSDF Leachate	2-2				
3.0 Descriptions of Major ARWWT Components	3-1				
3.1 Groundwater Component	3-1				
3.1.1 Current Groundwater Restoration Modules	3-2				
3.1.1.1 South Plume Module	3-2				
3.1.1.2 South Field Module	3-2				
3.1.1.3 Waste Storage Area Module	3-3				
3.1.2 Groundwater Collection and Conveyance	3-4				
3.1.3 Great Miami Aquifer Remedy Performance Monitoring	3-4				
3.2 Other Site Wastewater Sources	3-5				
3.3 Treatment Systems	3-5				
3.3.1 CAWWT Facility	3-5				
3.4 Ancillary Facilities	3-6				
3.4.1 Great Miami Aquifer	3-6				
3.4.2 CAWWT Backwash Basin	3-6				
3.4.3 SWRB Valve House	3-6				
3.4.4 South Field Valve House	3-7				
3.4.5 Parshall Flume	3-7				
3.4.6 OSDF Leachate Transmission System Permanent Lift Station (LTS PLS)	3-7				

TABLE OF CONTENTS (Continued)

	<u>Page</u>			
3.5 Current Treatment Performance	3-7			
3.6 Current and Planned Discharge Monitoring	3-7			
3.6.1 NPDES Monitoring	3-7			
3.6.2 Radionuclide and Uranium Monitoring	3-8			
3.6.3 IEMP Surface Water and Treated Effluent Monitoring Program	3-10			
4.0 Projected Flows	4-1			
4.1 Groundwater	4-1			
4.1.1 On-Site Disposal Facility (OSDF) Leachate	4-1			
5.0 Operations Plan	5-1			
5.1 Wastewater Treatment Operations Philosophy	5-1			
5.2 CAWWT Operation	5-1			
5.2.1 Ion Exchange Vessel Rotation	5-2			
5.3 Groundwater Treatment	5-2			
5.3.1 Groundwater Treatment Prioritization vs. Bypassing				
5.4 Well Field Operational Objectives				
5.5 Operational Maintenance Priorities	5-3			
5.6 Operations Controlling Documents	5-4			
5.7 Management and Flow of Operations Information	5-4			
5.8 Management of Treatment Residuals	5-4			
6.0 Operations Performance Monitoring and Maintenance	6-1			
6.1 Management Systems	6-2			
6.1.1 Maintenance and Support	6-2			
6.1.2 Operations	6-2			
6.1.2.1 Process Control	6-3			
6.1.2.2 Standard Operating Procedures	6-3			
6.1.2.3 Conduct of Operations	6-4			
6.1.2.4 Training	6-4			
6.2 Restoration Well Performance Monitoring and Maintenance	6-4			
6.2.1 Restoration Well Descriptions	6-5			
6.2.2 Factors Affecting System Operation	6-8			
6.2.3 Maintenance and Operational Monitoring	6-9			
6.3 Treatment Facilities Performance Monitoring and Maintenance	6-14			
6.3.1 Treatment Facilities Performance Monitoring	6-14			
6.3.2 Treatment Facilities Maintenance Practices	6-14			
6.4 Regulatory Issues				

TABLE OF CONTENTS (Continued)

	Page
7.0 Organizational Roles, Responsibilities, and Communications	7-1
7.1 Organization Roles and Responsibilities	7-1
7.1.1 DOE-LM Fernald	7-1
7.1.2 Operating Contractor	7-1
7.2 Regulatory Agency Interaction	7-3
References	R-1

LIST OF FIGURES

Figure 3-1	ARWWT Facilities Location Map
Figure 3-2	AWWT Timeline
Figure 3-3	Extraction Wells for the Groundwater Remedy
Figure 3-4	Current Groundwater Remediation/Treatment Schematic
Figure 3-5	Groundwater Certification Process and Stages
Figure 3-6	CAWWT Process Flow Diagram
Figure 3-7	Monthly Average Uranium Concentration in the Effluent to the Great Miami River at PF4001
Figure 3-8	IEMP Surface Water and Treated Effluent Sample Locations
Figure 6-1	South Plume Module Extraction Well Installation Details
Figure 6-2	South Field Module and Waste Storage Area Extraction Well Installation Details

LIST OF TABLES

Table 3-1	Well Field Operating Status
Table 4-1	Target Extraction Rate Schedule
Table 5-1	Well Field Operational Objectives
Table 6-1	Planned Outages of the South Plume Module Wells
Table 6-2	Planned Outages of the South Field and Waste Storage Area Module Wells

LIST OF ACRONYMS

ARARs applicable or relevant and appropriate requirements

ARWWP Aquifer Restoration Wastewater Project

ARWWT Aquifer Restoration and Wastewater Treatment

AWWT Advanced Wastewater Treatment Facility

BRSR Baseline Remedial Strategy Report

CAWWT Converted Advanced Wastewater Treatment Facility

D&D decontamination and demolition DOE U.S. Department of Energy

EPA U.S. Environmental Protection Agency ESD Explanation of Significant Differences

EW extraction well

FFCA Federal Facilities Compliance Agreement

FRL Final Remediation Level HMI human-machine interface

IEMP Integrated Environmental Monitoring Plan

LM Legacy Management

LTS Leachate Transmission System

NPDES National Pollutant Discharge Elimination System

OAC Ohio Administrative Code

OEPA Ohio Environmental Protection Agency
OMMP Operations and Maintenance Master Plan

OSDF On-Site Disposal Facility

OU5 Operable Unit 5

pcs process control station
PLS Permanent Lift Station

RA remedial action RD remedial design

RD/RA remedial design/remedial action

RI/FS remedial investigation/feasibility study

RM river mile

ROD Record of Decision RW recovery well

SWRB Storm Water Retention Basin

UCL upper confidence level VFD variable frequency drive

WSA waste storage area

LIST OF MEASUREMENT ABBREVIATIONS

ft/sec feet per second
gpm gallons per minute
µg/L micrograms per liter
mg/L milligrams per liter
ppb parts per billion
lbs/gal pounds per gallon
lbs/yr pounds per year

1.0 INTRODUCTION

This document is the Operations and Maintenance Master Plan (OMMP) for Aquifer Restoration and Wastewater Treatment (ARWWT) at the U.S. Department of Energy's (DOE's) Fernald Site. The OMMP is a formal remedial design deliverable, originally prepared to fulfill Task 2 of the Operable Unit 5 Remedial Design (RD) Work Plan (DOE 1996a). It was first issued in November of 1997. The OMMP has undergone three previous revisions, which were issued in December 1999, April 2005, and January 2006. This is the fourth revision, and has been prepared to address the post closure period, after the Site has been turned over to Legacy Management (LM).

1.1 SCOPE OF ARWWT AND OBJECTIVES OF OMMP

The scope of ARWWT includes the operation and maintenance of the Site's groundwater and the On-Site Disposal Facility's (OSDF) leachate management facilities.

The fundamental objectives of the OMMP are to guide and coordinate the extraction, collection, conveyance, treatment, and discharge of all groundwater and leachate during the post-closure period. Compliance with discharge limits includes a plan of the commitments, performance goals, operating schedule, treated water flow rates, direct discharge flow rates, and other operating priorities. This plan also provides the approach for the management of treatment residuals (backwash basin sediments, and spent resins/filtration media) that are by-products of the Fernald Site's wastewater treatment processes.

The OMMP serves as a comprehensive statement of management policy to ensure that planned modes of operation and maintenance for ARWWT are consistent with regulatory requirements and satisfy the Fernald Site's remedy performance commitments for groundwater restoration and wastewater treatment. The plan establishes the decision logic and priorities for the major flow and water treatment decisions needed to maintain compliance with the Fernald Site's National Pollutant Discharge Elimination System (NPDES) permit and Record of Decision-based surface water discharge limits. The plan also provides the overall management philosophy and decision parameters to implement the day-to-day flow routing, critical-component maintenance, and treatment priority decisions. It is not intended to provide detailed, specific operating or maintenance procedures for ARWWT. The plan also serves to inform U.S. Environmental Protection Agency (EPA) and the Ohio Environmental Protection Agency (OEPA) of the planned operational approaches and strategies that are intended to meet the regulatory agreements made during the Operable Unit 5 Remedial Investigation/Feasibility Study (RI/FS) (DOE 1995b, DOE 1995a) process and documented in the Operable Unit 5 decision documents; the Operable Unit 5 Record of Decision (DOE 1996a), the Operable Unit 5 Explanation of Significant Differences, and the Operable Unit 5 Remedial Design Fact Sheet for Fernald Site Wastewater Treatment Updates (DOE 2004).

. . . ' . . [48. . . .]

The plan provides the basis for development of more detailed internal operating procedure documents (e.g., Standard Operating Procedures, Standing Orders, and Preventive Maintenance Plans) that are required for execution of work at the Fernald Site. The existing detailed procedural documents that govern the performance of water-related operations and maintenance activities at the Fernald site are expected to be updated (revised, combined, or eliminated) as required to conform to the general strategies, guidelines, and decision parameters defined in this plan.

1.2 BASIS AND NEED

The need for the OMMP arose in the mid 1990s, as DOE and regulators realized that the various water and wastewater flows that originate from Fernald Site remediation activities were in direct competition with one another for treatment resources. The wastewater treatment capacities at the Fernald Site had to be prioritized so that: 1) discharge limits could be maintained; 2) a range of flow conditions at various time intervals could be accommodated; and 3) the detrimental effects of exceptional operating circumstances can be effectively managed. The need for treatment (and the accompanying hierarchy of treatment priorities) has varied over the span of the site remedy as new projects came on line, others were completed, and aquifer restoration activities progressed.

It was recognized during the development of the Operable Unit 5 Record of Decision, that the monthly average concentration discharge limit for total uranium (established at 20 parts-per-billion [ppb] in the Operable Unit 5 Record of Decision and revised to 30 ppb in the Operable Unit 5 Explanation of Significant Differences) could probably be met under average operating conditions, but that maintaining the limit may not be achievable during periods of exceptional operating conditions. It was further recognized that the application of the discharge limit was not considered as a required component of the remedy to ensure protectiveness, but rather as an appropriate performance-based objective that appeared reasonably attainable through the application of an appropriate level of water treatment. It was recognized that the performance-based discharge limit must be able to accommodate exceptional operating conditions anticipated to occur over the duration of the remedy. Two exceptional operating conditions were actually cited in the Operable Unit 5 Record of Decision that would permit relief allowances from the total uranium monthly average concentration discharge limit, when necessary, for:

- Storm water bypasses during high precipitation events
- Periodic reductions in treatment plant operating capacity that are necessary to accommodate scheduled maintenance activities.

Since storm water treatment is no longer required (other than a portion of the Converted Advanced Wastewater Treatment [CAWWT] footprint), storm water bypasses are no longer required. It was agreed, at the time the Record of Decision was signed, that the OMMP would define the operating philosophy

for: 1) the extraction/re-injection and treatment systems; 2) establishment of operational constraints and conditions for given systems; and 3) establishment of the process for reporting and instituting corrective measures to address exceedances of discharge limits. The OMMP also contains details of the manner in which exceptional operating conditions are to be accommodated and reported in the demonstration of discharge limit compliance.

The OMMP will be modified during the course of the remedy to accommodate changes to the treatment and well field systems or the retirement of individual restoration modules from service, once area-specific cleanup levels are achieved. The plan is intended to serve as a living guidance document to instruct operations staff in implementing required adjustments to the system over time. The OMMP will thus be evaluated periodically to ensure the most recent instructions regarding treatment priorities and flow routing decisions are available to system operators. Proper notifications for reporting maintenance shutdowns of the system, and the reporting and application of corrective measures to address exceedances of discharge limits also are identified in the OMMP.

Prior to site closure in 2006, water treatment flows were reduced to groundwater and leachate from the OSDF. Elimination of remediation wastewater, impacted storm water and sanitary wastewater provided an opportunity to reduce the size of the water treatment facility remaining to service the aquifer restoration and leachate treatment after site closure. Reducing the size of the treatment facility prior to site closure in 2006 reduced the amount of impacted materials that may need future off-site disposal.

Between October 2003 and March 2004, DOE conducted a series of meetings with public stakeholders, the EPA, and the Fernald Citizen's Advisory Board to identify a more cost effective water treatment facility that would serve as a long-term replacement for the existing Advanced Wastewater Treatment (AWWT) facility. The interactions led to support for a plan to carve down the AWWT facility to permit the 1,800 gallons per minute (gpm) Phase III expansion system to remain as the long-term groundwater treatment facility. The converted 1,800 gpm AWWT facility (CAWWT) provided 1200 gpm capacity for groundwater and about 600 gpm of storm water capacity (including carbon treatment) to handle the last remaining storm water and remediation wastewater flows prior to site closure. Since those flows have ceased, the CAWWT now provides a dedicated long-term groundwater treatment capacity of up to 1,800 gpm.

In addition to decreasing the size of the water treatment facility, operational approaches to the aquifer remedy were re-evaluated and resulted in the elimination of well-based groundwater re-injection since it was determined that this was not a cost effective approach to aquifer restoration at Fernald. This OMMP

reflects the Aquifer restoration design provided in the Waste Storage Area Phase II Aquifer Restoration Design Report.

1.3 RELATIONSHIP TO OTHER DOCUMENTS

The OMMP functions in tandem with several other major ARWWT design documents and support plans (i.e., Integrated Environmental Monitoring Plan (IEMP), various aquifer restoration module design packages, Remedial Action (RA) Work Plan, and the Fernald Groundwater Certification Plan.)

The environmental monitoring and reporting activities conducted in support of aquifer restoration performance decisions are specified in the Integrated Environmental Monitoring Plan (IEMP) (DOE 2006b). Information obtained through the IEMP will be used to: (1) appraise groundwater restoration progress; (2) assess the need for changing groundwater extraction flow rates; and (3) assess the durations of groundwater extraction activities over the life of the remedy.

The initial design flow rates, planned installation sequence, detailed design basis, and overall restoration strategy for the aquifer restoration modules comprising the groundwater remedy were developed in the Baseline Remedial Strategy Report (BRSR) for Aquifer Restoration (DOE 1997a). The overall restoration strategy has been modified as a result of information gained from the ongoing remedy performance/operations monitoring and pre-design monitoring conducted in support of the Waste Storage Area (Phases I and 2) Modules and the South Field Extraction System (Phase II) Module.

The Remedial Action (RA) Work Plan (DOE 1997b) for Aquifer Restoration (submitted to EPA and OEPA as Task 10 of the Operable Unit 5 RD Work Plan) conveyed the enforceable RA construction schedule for the initial restoration modules brought on-line in 1998 (the Re-injection Demonstration Module, the South Field Extraction System Module, and the South Plume Optimization Module). It also contained the planning-level RA construction schedule for the remaining modules to be brought online in later years. With the completion and start-up of the Waste Storage Area Phase I Module in 2002 and the South Field Phase II Module in 2003, all of the RA Work Plan specified schedules have been met.

The Fernald Groundwater Certification Plan defines a programmatic strategy for certifying completion of the aquifer remedy (DOE 2006c). The Certification Plan establishes the processes that will be used to achieve groundwater restoration and conduct certification. The preferred outcome is to certify that the Operable Unit 5 (OU5) Record of Decision groundwater remediation goals have been achieved using the pump-and-treat remediation system that is currently operating at the site. The plan also covers other potential contingencies and exit scenarios. Any change to the operation of the aquifer remedy system needed to achieve certification will be controlled through the OMMP.

The OMMP has functioned in tandem with several other RD or design support plans prepared by other project organizations outside ARWWT. All the other site remediation projects have been completed, therefore; there is no longer a need to interface with other projects as only a small flow of leachate from the OSDF and groundwater remain to be treated.

1.4 PLAN ORGANIZATION

The plan is generally organized around the wastewater streams being managed by ARWWT: The sections and their contents are as follows:

- Section 1.0 Introduction: presents an overview of the plan, its objectives, and its relationship to other documents, and its organization.
- Section 2.0 Summary of Regulatory Drivers and Commitments: discusses the applicable or relevant and appropriate requirements (ARARs) compliance crosswalk and provides a summary of the other commitments and guidelines that have been activated for ARWWT by the Operable Unit 5 Record of Decision.
- Section 3.0 Description of ARWWT Major Components: identifies the major collection, conveyance, and treatment components comprising the Fernald site's system for managing groundwater and leachate, the treatment capacities that are available, and a schedule of major ARWWT activities throughout the aquifer restoration process.
- Section 4.0 Projected Flows: provides an estimate of flow generation rates and durations for groundwater and leachate.
- Section 5.0 Operations Plan: establishes the operations philosophy, treatment priorities and hierarchy, treatment operational decisions, well field operational objectives and decisions, maintenance priorities, controlling documentation, management and flow of operations information to successfully operate the groundwater and leachate transmission systems to achieve regulatory requirements and commitments.
- Section 6.0 Operations and Maintenance Methods: addresses the general methods, guidelines, and practices used in managing equipment operation and maintenance; discusses some of the dedicated organizational resources and management systems that will help to assure meeting the requirements in the Record of Decision, describes the key parameters used to monitor the performance of the groundwater and wastewater facilities, and describes the principal features and maintenance needs for the overall operation.
- Section 7.0 Organizational Roles, Responsibilities, and Communications: this section presents the organizational roles and responsibilities with respect to implementation of this OMMP.

 Also presented are communications protocol for coordination with the EPA and OEPA.
- Appendix A Listing of ARWWT Standard Operating Procedures

1.5 PROGRAM MODIFICATIONS AND REVISIONS

The OMMP will remain in place for the duration of the Fernald Site's remediation activities. Periodic reviews of the OMMP will be conducted to respond to needed changes in program emphasis or the addition of new components, as appropriate.

2.0 SUMMARY OF REGULATORY DRIVERS AND COMMITMENTS

Regulatory drivers and commitments as they pertain to the successful operation of the CAWWT and associated groundwater extraction systems involve the specific effluent limits that need to be met and source water treatment requirements. There are other regulatory requirements, legal agreements, and agency commitments that apply to the site as a whole and as such may have applicability to CAWWT. However, these general Fernald site drivers and commitments are not further discussed in this section.

2.1 DISCHARGE LIMITS:

The discharges from the Fernald Site to the Great Miami River are primarily associated with the groundwater remedy involving the treated effluent (primarily groundwater) from the CAWWT and extracted groundwater that is discharged without treatment. A small amount of leachate from the OSDF is also managed through the CAWWT facility. In addition, it is possible that from time to time treatment may need to be applied to storm water runoff that has been collected in former excavations in the former production area and former waste storage area. The combined effluent from the CAWWT facility is discharged to the Great Miami River through the Parshall Flume Building, which is the final monitoring point prior to reaching the Great Miami River. The required effluent limits for this discharge are governed by the Operable Unit 5 Record of Decision (ROD) for the uranium component of the discharge and by the NPDES Permit (Permit No. 11000004*GD) for the non-uranium parameters.

2.1.1 Operable Unit 5 Record of Decision

Treatment will be applied to all discharges to the Great Miami River, to the extent necessary, to limit the total mass of uranium discharged through the Fernald site outfall to the Great Miami River to no more than 600 pounds per year. This mass based discharge limit became effective upon issuance of the Operable Unit 5 ROD. Additionally, the necessary treatment will be applied to limit the concentration of total uranium in the blended effluent to the Great Miami River to no greater than 30 ppb. The 30 ppb discharge limit for uranium will be based on a monthly flow-weighted average. This limit became effective December 1, 2001 based on the Operable Unit 5 Explanation of Significant Differences which replaced the original 20 ppb standard to which the Fernald site was subject beginning January 1, 1998.

There are specific circumstances stipulated in the Operable Unit 5 ROD that necessitate relief from the concentration limit. Up to 10 days per year are allowed by the ROD for emergency bypass due to storm events. However, this allowance only applied when storm water was being collected in the Stormwater Retention Basin (SWRB) recognizing the SWRB's capacity limitations and the desire to prevent an overflow of the SWRB to the Storm Sewer Outfall Ditch and Paddys Run to the extent possible. The SWRB was taken out of service in February 2006. The other instance when relief can be requested involves maintenance activities. Approval by the EPA must be obtained in advance by notification of these planned maintenance periods. The notification must be accompanied by a request for the uranium concentrations in the discharge not to be considered in the monthly averaging performed to demonstrate

compliance with the 30 ppb total uranium limit. Uranium contained in these bypass events will only be counted in the annually discharged mass, but not in the monthly average concentration calculations.

2.1.2 NPDES Permit:

Under the Clean Water Act as amended, the Fernald site is governed by NPDES regulations that require the control of discharges of non-radiological pollutants to waters of the State of Ohio. The NPDES Permit, issued by the State of Ohio, specifies discharge and sample locations, sampling and reporting schedules, and discharge limits. The Fernald site submits monthly reports on NPDES activities to OEPA. The Fernald Site's current NPDES Permit, Permit No. 110000004*GD, became effective on July 1, 2003

2.2 SOURCE WATER TREATMENT REQUIREMENTS:

There are three sources of wastewater that have specific management requirements. Groundwater, OSDF leachate, and storm water.

2.2.1 Groundwater

Groundwater treatment decisions are made based on individual well uranium concentrations. The higher concentration wells go to treatment and the lower concentration wells bypass treatment and are discharged directly to the Great Miami River outfall line. The piping networks that convey on-property extracted groundwater have double headers, one connected to the main line to treatment and the other to the main discharge line. This design feature is not applicable to the off-property South Plume Module. The extracted groundwater from the South Plume Module is sent to either the treatment facilities or directly to the discharge outfall based on the uranium concentration in the combined flow from the 6 wells comprising this Module. The combined treated and untreated discharge will comply with the 30 ppb discharge limit and the 600 pound per year mass-based limit as described above under Discharge Limits.

2.2.2 Storm Water

It is not anticipated that treatment of any storm water will be required since soil remediation/certification has been completed. Storm water treatment can be provided though on a limited basis, if needed but the infrastructure to collect transfer and store storm water has been removed as a consequence of site remediation.

2.2.3 OSDF Leachate

Ohio Administrative Code (OAC) 3745-27-19, Operational Criteria for a Sanitary Landfill Facility, requires treatment of leachate. Leachate is a minimal flow and will likely have no bearing on operational decisions. It is required however, that leachate is to be treated through the CAWWT prior to discharge to the Great Miami River until the CAWWT is no longer required. Prior to the cessation of CAWWT operations, DOE will have proposed and negotiated the future management of leachate with the EPAs.

3.0 DESCRIPTIONS OF MAJOR ARWWT COMPONENTS

The major operating system components required to accomplish aquifer remedy commitments and goals are described in this section. The site conveyance and treatment system components for managing the major wastewater streams are identified, as are treatment capacities. This section also describes key linkages between the components. Figure 3-1 depicts the facilities as well as groundwater wells on a projected view of the site. Figure 3-2 provides a timeline of major activities that have occurred and those that are projected to occur throughout the aquifer restoration process.

3.1 GROUNDWATER COMPONENT

The remediation of the Great Miami Aquifer will be achieved by completing area-specific groundwater restoration modules. These modules were specified in the following documents:

- Remedial Action/Remedial Action (RD/RA) Work Plans for Operable Unit 5
- Baseline Remedial Strategy Report for Aquifer Restoration
- Design for the Remediation of the Great Miami Aquifer in the Waste Storage and Plant 6 Areas (DOE 2001a)
- Design for Remediation of the Great Miami Aquifer South Field (Phase II) Module (DOE 2002).
- Waste Storage Area (Phase II) Design Report (DOE 2005)

During 2003, new information became available (refer to Comprehensive Groundwater Strategy Report [Fluor Fernald, Inc. 2003]) that allowed for more refined groundwater modeling predictions of when aquifer restoration would be completed. The updated modeling predictions and groundwater remedy performance monitoring data both indicated the aquifer restoration time frame would likely be extended beyond the dates previously predicted. The updated modeling also indicated that the use of groundwater reinjection via wells did not greatly reduce the time required to remediate the aquifer. As reflected in Figure 3-2, aquifer restoration activities are predicted to be necessary beyond the year 2020.

A programmatic strategy for certifying completion of the aquifer remedy was approved by EPA in 2005 via the Fernald Groundwater Certification Plan. The Fernald Groundwater Certification Plan establishes the processes that will be used to achieve groundwater restoration and conduct certification of the aquifer remedy. The Certification Plan relies on the IEMP and the OMMP for implementation of that process.

3.1.1 Current Groundwater Restoration Modules

Groundwater restoration modules currently in operation are:

- South Plume
- South Field (Phases I and II)
- Waste Storage Area (Phases I and II)

The geographical locations of each of these modules and associated wells are provided in Figure 3-3. A description of each of the modules is provided in the following subsections.

3.1.1.1 South Plume Module

Five extraction wells were installed in 1993 at the leading edge of the off-property South Plume as part of the South Plume removal action to gain an early start on groundwater restoration. The South Plume removal action well system began pumping in August 1993. The primary intent of the original five well system was to prevent further off-property migration of contamination within the groundwater plume. Two additional extraction wells came online in August 1998 for the active restoration of the central portion of the off-property plume. These two new wells, known as the South Plume Optimization Module have now been incorporated into the South Plume Module for purposes of remedy performance tracking and reporting. Figure 3-3 shows the locations of the wells and Table 3-1 provides the operating status of the South Plume Module.

3.1.1.2 South Field Module

The South Field Module was installed in two phases. South Field Extraction System Phase I Module includes 10 extraction wells. In 1996, as part of an EPA-approved early start initiative, the 10 extraction wells were installed on Fernald site property in the vicinity of the south field/storm sewer outfall ditch. These wells are removing groundwater contamination in an on-property area of the Southern Uranium Plume.

Since the installation of the 10 original extraction wells of the South Field Extraction (Phase I) Module three new extraction wells have been added to the module, three of the original wells have been shut down, and one of the original wells has been converted to a re-injection well. The three extraction wells that were shut down are all located in the upgradient area of the plume where total uranium concentrations in the Great Miami Aquifer are now below the Final Remediation Level (FRL). An additional consideration in removing two of these three wells was to accommodate soil remedial activities in the vicinity of the wells.

The three new wells added to the South Field Phase I Module were installed at locations where total uranium concentrations were considerably above the groundwater FRL, in the eastern, downgradient portion of the South Field plume. Two of the three new wells were installed in late 1999 and began pumping in February 2000. The third well was installed in 2001 and will become operational in 2002.

Phase II components of the South Field became operational in 2003. The components include:

- Four additional extraction wells, one in the southern waste unit area, and three along the eastern edge of the on-property portion of the southern uranium plume.
- One additional re-injection well in the southern waste unit area. All re-injection wells have been removed from service.
- A converted extraction well, which was converted into a re-injection well. All re-injection wells have been removed from service
- An injection pond, which is located in the western portion of the Southern Waste Units Excavations. The injection pond was removed from service along with all the re-injection wells.

Table 3-1 provides the operational status of the currently configured South Field Extraction System Module (Phase I and Phase II components).

3.1.1.3 Waste Storage Area Module

The Waste Storage Area Module was designed and installed in two phases. The Waste Storage Area Extraction system targets contaminants in the Great Miami Aquifer underlying the waste storage area (Operable Units 1 and 4). The geographical location of the Waste Storage Area module is provided in Figure 3-3. The Design for Remediation of the Great Miami Aquifer in the Waste Storage Area and Plant 6 Areas defines the Phase I design. Phase I addresses the plume of contamination defined in the vicinity of the Pilot Plant Drainage Ditch. The Waste Storage Area (Phase II) Design Report defines the Phase II Design. Phase II addresses the plume of contamination defined in the vicinity of the former waste pit areas.

Phase I of the Waste Storage Area Module consists of one 12-inch diameter well and two 16-inch diameter extraction wells complete with submersible pumps with variable speed drives, well houses, electrical power, instrumentation and controls, fiber optic communications, and dual discharge headers (one for treatment and one for direct discharge). Initiation of operation of this phase of the module was May 8, 2002. The easternmost well in the Phase I design (Extraction Well 33063 or EW-28) was taken out of service then plugged and abandoned in July 2004 to make way for soil remediation activities. The well was replaced in 2005 and was brought online in 2006 prior to transition of the site from DOE-EM to DOE-LM.

The Design for Remediation of the Great Miami Aquifer in the Waste Storage Area and Plant 6 Area concluded that the uranium concentrations in the Great Miami Aquifer beneath Plant 6 had naturally attenuated to concentrations below 20 ppb. While the current data indicate that no extraction wells and infrastructure will be needed for the Plant 6 area, monitoring of the Plant 6 area will continue until aquifer restoration certification is completed and approved by EPA and OEPA.

Phase II of the Waste Storage Area module consists of one 16-inch diameter well with a submersible pump, variable speed drive, well house, electrical power, instrumentation and controls, fiber optic communications, and a dual discharge header

3.1.2 Groundwater Collection and Conveyance

An extensive system of collection and conveyance piping systems is required for the remediation of the Great Miami Aquifer. These piping systems were specified in the various module-specific design documents. Figure 3-4 provides an overview of the current well field piping.

As described in Section 2, the piping network that conveys on property extracted groundwater from the individual extraction wells has double headers, one connected to the main line to treatment and the other to the main discharge line as shown in Figure 3-4. The double headers allow for treatment/bypass decisions to be made on an individual well basis for the on-property wells. This design feature is not applicable to the off-property South Plume Module which was largely in place prior to the design of the on-property piping network. Since individual well bypass/treatment lines are not available on the South Plume wells, treatment/bypass decisions for the six wells comprising this system are made based on the uranium concentration in the combined flow from all the wells as indicated on Figure 3-4.

3.1.3 Great Miami Aquifer Remedy Performance Monitoring

Section 3 of the IEMP provides for the routine remedy performance monitoring of the Great Miami Aquifer. The details of how the remedy performance data are being evaluated and the associated decision making process are located in Section 3.7 of the IEMP. Figure 3-5 illustrates the Groundwater Certification Process for the Aquifer Remedy. As illustrated in Figure 3-5, remedy performance monitoring is being conducted to assess the efficiency of mass removal and to gauge performance in meeting remediation objectives. If it is determined that aquifer restoration program expectations (as identified in the IEMP) are not being met, then the design and operation of the aquifer restoration system will be evaluated to determine if a change needs to be implemented. A change to the operation of the aquifer restoration system would be implemented by a modification to this OMMP. A groundwater monitoring change, if found to be necessary, would be implemented through the IEMP review and approval process. If additional characterization data is needed (e.g., to determine the nature of a newly detected FRL exceedance) a modification to the IEMP

would be implemented, or a new sampling plan would be prepared depending upon the anticipated size of the activity.

Prior to operating any required new extraction wells, additional monitoring wells are installed to help monitor the performance of the new wells. The new extraction wells are also monitored for uranium concentration on a frequent basis just after start-up. The site-wide groundwater data collected via the IEMP is utilized to assess the performance of the site-wide groundwater remedy. The data derived from the additional monitoring wells and new extraction well uranium monitoring is integrated with the IEMP groundwater monitoring such that area-wide interpretations can be made. Changes to the scope of the routine monitoring identified in the IEMP may be necessary based on the findings of the sampling conducted in the new monitoring and extraction wells. These changes would be accommodated as necessary through the prescribed IEMP review process.

The details of the annual reporting of groundwater remedy performance information are also provided in the IEMP, Section 3.7. The reporting subsection provides the specific information to be reported in the comprehensive annual report.

3.2 OTHER SITE WASTEWATER SOURCES

Leachate from the On-Site Disposal Facility is the only other significant source of wastewater to be treated. Small amounts of wastewater from the extraction well rehabilitation process are generated periodically. This wastewater is also treated. A small amount of storm water from portions of the CAWWT footprint will be collected and treated as necessary.

3.3 TREATMENT SYSTEMS

As noted in Section 1, with site closure in 2006, several water treatment flows were eliminated or greatly reduced (i.e., remediation wastewater, sanitary wastewater, storm water runoff) from the scope of the treatment operation. Elimination/reduction of these flow streams provided an opportunity to reduce the size of the water treatment facility that will remain to service the aquifer restoration after site closure. The various facility shutdown dates are provided in Figure 3-2.

3.3.1 CAWWT Facility

As noted in Section 1, the AWWT Expansion system was "converted" to the long-term groundwater treatment facility. The CAWWT provides a dedicated long-term groundwater treatment capacity of up to 1800 gpm. The CAWWT process flow diagram is provided in Figure 3-6. The unit processes of the CAWWT system include granular multimedia filtration and ion exchange on all 3 trains.

Operating the CAWWT to meet uranium discharge limits will most likely no longer be required sometime between 2007 and 2011. The test pump model is used to predict how long groundwater treatment will be required in order to meet uranium discharge limits. This model uses a spreadsheet to calculate a flow-weighted discharge concentration, based on pre-defined pumping rates of the extraction wells, pre-defined treatment capabilities, and uranium concentrations measured in water pumped from the extraction wells. The current prediction of how long treatment will be needed is based on constant pumping rates defined for Modeling Approach C, treatment capabilities defined in the OMMP, and uranium concentration data collected at the extraction wells through 2004.

The 2007 prediction is based on trending actual concentration data collected at extraction wells. The 2011 prediction is based on trending the 95 percent upper confidence level (UCL) of actual concentration data collected at extraction wells.

3.4 ANCILLARY FACILITIES

A number facilities support the operation of aquifer restoration and the treatment system. These facilities include headworks for equalizing flow, groundwater flow routing facilities, wastewater collection and transfer facilities, and discharge monitoring facilities.

3.4.1 Great Miami Aquifer

No specific headworks exist for groundwater. However, because this flow can be adjusted by regulating the extraction wells, the aquifer itself serves as the headworks for groundwater.

3.4.2 CAWWT Backwash Basin

The CAWWT facility includes a backwash basin. This basin is a 100 foot by 100 foot by 6 foot deep above ground lined basin that was installed during December, 2005 – January 2006 and became operational the week of January 30, 2006. The basin was designed to contain the last remaining impacted storm water prior to site closure and to serve as the facility to contain backwash water from the CAWWT multimedia filters and ion exchange vessels for the duration of CAWWT operations. The basin has an approximate working capacity of up to 400,000 gallons to allow for a minimum of six inches of freeboard at all times. The basin contains a baffle to separate the influent from the effluent and allow any solids backwashed from the filters and IX vessels to settle prior to discharge back into the CAWWT treatment system.

3.4.3 SWRB Valve House

The SWRB Valve House contains pipes that direct groundwater flow to the CAWWT for treatment. This facility also serves as the point of convergence for the effluent from the treatment system prior to discharge through the Fernald site outfall pipeline.

3.4.4 South Field Valve House

As part of the South Field Extraction System Phase I construction, a new south field valve house was constructed, upstream of the SWRB Valve House. The primary purpose of this valve house is to receive the combined South Plume Recovery System groundwater. It directs all or portions of the combined flow toward treatment and/or to untreated discharge prior to combining with other groundwater flows.

3.4.5 Parshall Flume

Downstream of the SWRB Valve House, the combined flows pass through a Parshall flume and an associated outfall monitoring station for Fernald site discharge flow measurement and monitoring.

3.4.6 OSDF Leachate Transmission System Permanent Lift Station (LTS PLS)

Leachate from the OSDF gravity drains to the valve houses located on the west side of each cell. From the valve houses the leachate is routed to the LTS PLS. When sufficient leachate collects in the PLS it is pumped to CAWWT for treatment.

3.5 CURRENT TREATMENT PERFORMANCE

The performance of the ARWWT treatment systems measured against the overriding goal of meeting Operable Unit 5 Record of Decision discharge standards relative to uranium as well as NPDES effluent limits has been satisfactory. The uranium mass loading limit of 600 pounds per year (lbs/yr) has been met every year since the requirement became effective in January 1998. As depicted on Figure 3-7, the monthly average concentration has been met every month since January 1998 with the exception of five months. The Fernald site has been in compliance with NPDES effluent limits well in excess of 99 percent of the time since January 1995; the date the AWWT Phases I and II were placed into service.

3.6 CURRENT AND PLANNED DISCHARGE MONITORING

Currently, discharge monitoring is completed under two sampling programs. Conventional pollutants are monitored under the NPDES. Radionuclides and total uranium are monitored under the Operable Unit 5 Record of Decision and the Federal Facilities Compliance Agreement (FFCA). These two programs have been incorporated into the IEMP sampling program as described in Section 4 of the IEMP. These monitoring programs are described briefly in the subsections below.

3.6.1 NPDES Monitoring

There are eight locations monitored under the current NPDES Permit; six of which relate to permitted Fernald site wastewater/storm water discharge outfalls to State of Ohio waters and two related to upstream and down stream monitoring (relative to the Fernald site outfall line) of the Great Miami River (see Figure 3-8). The permit (Ohio EPA Permit No. 11000004*GD) is administered by OEPA and

granted to the DOE at the Fernald site. The effluent pollutant limitations, monitoring requirements, and reporting requirements are specified in the permit for each of the eight monitored locations.

Discharges through Outfall 4001 enter the Great Miami River at River Mile 24.73. The sampling and monitoring location for this outfall is the Parshall Flume chamber immediately downstream from Manhole 176B. This outfall is the primary Fernald site wastewater discharge outfall consisting of discharges from the CAWWT facilities, and untreated groundwater.

Discharges through Outfalls 4003, 4004, 4005, and 4006 are untreated storm water runoff from uncontrolled drainage basins into Paddys Run. Runoff from eastern and southern areas of the site drains through Outfall 4003, which is just north of Willey Road. Runoff from the area north and west of the former inactive flyash pile drains through Outfall 4004, which is just west of the former flyash pile. Runoff from the western area of the site drains through Outfall 4005, which is just south of the former K-65 Silos. Runoff from areas north of the site drains through Outfall 4006, which is north of former Waste Pit 5.

Location 4801 is a location upstream of the Fernald site outfall line in the Great Miami River and is collected from the Venice Bridge (RM 26.2). This location serves as the background location under the IEMP. Location 4902 is the location down stream from the Fernald site outfall line and is collected from the new New Baltimore Bridge (RM 21.4).

There are two outfalls that remain in the current NPDES Permit but no further discharge through these points will occur. These points will be the subject of a future permit modification. Outfall 4002 (Storm Water Retention Basin (SWRB) Spillway) will no longer see flow as the SWRB has been removed. Outfall 4601 was associated with the sewage treatment plant effluent; however, the sewage treatment plant has been removed from service and undergone decontamination and demolition..

3.6.2 Radionuclide and Uranium Monitoring

The Fernald site conducts a surface water sampling and analytical program for certain specific radionuclides which are potentially present in the regulated liquid effluent and in the uncontrolled storm water runoff from the site. Details of this program are provided in Section 4 of the IEMP. The program consists of uranium analysis of a daily flow-proportional composite sample of the site effluent and grab sampling at quarterly intervals. The monthly samples are analyzed for total uranium, radium-228 and technetium-99, while the quarterly samples are analyzed for lead-210, radium-226 and strontium-90.

The daily total uranium analysis of the site effluent to the Great Miami River is used to track compliance with Operable Unit 5 Record of Decision established limits. Since the issuance of the Operable Unit 5 Record of Decision in January 1996, the Fernald site is obligated to limit the total mass of uranium discharged through the Fernald site outfall to the Great Miami River to 600 lbs/yr.

This daily effluent uranium analysis is also used to demonstrate compliance with the monthly average uranium concentration of 30 ppb uranium in the site discharge to the river. The original requirement for compliance with a monthly average concentration became effective January 1, 1998, as established in the Operable Unit 5 Record of Decision. The Operable Unit 5 Record of Decision established this concentration at 20 ppb uranium, which was the compliance standard from January 1998 through November 2001. The monthly average concentration limit changed from 20 ppb to 30 ppb beginning December 1, 2001 as a result of EPA approval of the Explanation of Significant Differences (ESD) for Operable Unit 5 in November 2001. This Operable Unit 5 ESD changed the total uranium groundwater FRL from 20 ppb to 30 ppb as well as established the new monthly average concentration discharge standard. The 600 lbs/yr limit was unaffected by this ESD and remains in effect.

The average monthly uranium concentration is calculated by multiplying each daily flow by the uranium concentration of the flow-weighted composite sample for that respective day. The sum of the values obtained by multiplying the flow times the concentration is then divided by the sum of the flows for the month. The result is a flow-weighted average monthly uranium concentration. The daily flow-weighted concentrations are then multiplied by 8.35 (lb/gal) to obtain the daily pounds of uranium discharged. The sum of the daily masses for the year is used to compare against the 600-lbs/yr limit.

If the average monthly uranium concentration exceeds the 30 ppb limit, the excursion will be reported to the agencies. If a sequence of months (i.e., not a random occurrence) indicates an exceedance of the 30-ppb monthly average, then corrective measures will need to be evaluated. Depending on the reason for the sequence of exceedances, corrective actions could include: replacement of resin in CAWWT ion exchange vessels, segregation of the South Plume Optimization wells discharged from the combined South Plume Optimization/South Plume Recovery System header to reduce the concentration of uranium in flow bypassing treatment, or other such actions.

The need for corrective measures will be discussed with the EPA and OEPA in periodic meetings/reports. (Summary reporting of how the Fernald site is doing with respect to compliance with the 30-ppb uranium discharge limit and the use of bypass days will be included in the meetings/reports.) In the event that corrective measures are deemed necessary, the situation will be outlined to the EPAs in order to reach consensus regarding what action (if any) is required.

3.6.3 IEMP Surface Water and Treated Effluent Monitoring Program

Significant portions of the current and past programs (NPDES and FFCA) have been incorporated into the IEMP. Section 4 of the IEMP describes these two programs in more detail and also how these two programs have been integrated into the IEMP surface water and treated effluent sampling program. The IEMP also provides for additional monitoring above that required by the NPDES permit and the FFCA. This additional monitoring is performed as a supplement in order to monitor surface water and treated effluent for potential site impacts to various receptors during aquifer remediation. Figure 3-8 shows the current NPDES, FFCA, and the IEMP treated-effluent and surface-water sampling locations. In addition to identifying the sampling program requirements, the IEMP provides a comprehensive data evaluation and associated decision-making and reporting strategy for surface-water and treated-effluent.

TABLE 3-1
WELL FIELD OPERATING STATUS

South Plume RW-1 3924 08/27/93 Active South Plume RW-2 3925 08/27/93 Active South Plume RW-3 3926 08/27/93 Active South Plume RW-4 3927 08/27/93 Active South Plume RW-4 3927 08/27/93 Active South Plume RW-5 3928 08/27/93 Active South Plume RW-6 32308 08/09/98 Active South Plume RW-7 32309 08/09/98 Active South Plume RW-7 32309 08/09/98 Active South Plume RW-7 32309 08/09/98 Active SouthField EW-13 31565 07/13/98 Inactive Turned off 9/11/94, not needed SouthField EW-14 31564 07/13/98 Inactive Turned off 12/19/01 SouthField EW-15 31566 07/13/98 Inactive Turned off 12/19/01 SouthField EW-15 31566 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-16 31563 07/13/98 Inactive SouthField EW-17 31567 07/13/98 Inactive Turned off 9/6/05, replaced by EW-17A SouthField EW-18 31550 07/13/98 Active SouthField EW-19 31560 07/13/98 Active SouthField EW-20 31561 07/13/98 Active SouthField EW-21 31562 07/13/98 Active SouthField EW-21 31562 07/13/98 Active SouthField EW-21 332276 07/13/98 Active SouthField EW-21 332276 07/13/98 Active SouthField EW-24 33246 07/29/03 Active SouthField EW-24 33246 07/29/03 Active SouthField EW-25 33061 05/07/02 Active SouthField EW-32 33266 07/25/03 Active SouthField EW-32 33266 07/25/03 Active SouthField EW-32 33266 07/25/03 Active SouthField EW-33 33306 05/08/02 Active SouthField EW-33 33363 05/08/02 Active SouthField EW-33 33266 07/25/03 Active SouthField EW-34 33266 07/25/03 Active Active SouthField EW-34 33266 07/25/03 Active SouthField EW-32 33266 07/25/03 Active SouthField EW-34 33266 07/25/03 Active SouthField EW-34 33266 07/25/03 Active SouthField EW-34 33266 07/25/03 Active SouthFi	Module	Operations	SED	Date of Initial	Current	Notes
South Plume RW-2 3925 08/27/93 Active South Plume RW-4 3926 08/27/93 Active South Plume RW-4 3927 08/27/93 Active South Plume RW-5 3928 08/27/93 Inactive South Plume RW-6 32308 08/09/98 Active South Plume RW-7 32309 08/09/98 Active SouthField EW-13 31565 07/13/98 Inactive Turned off 9/11/94, not needed SouthField EW-13 31565 07/13/98 Inactive Turned off 9/11/94, not needed SouthField EW-15 31566 07/13/98 Inactive Turned off 12/19/01 SouthField EW-15a 33262 07/26/03 Active Turned off 12/19/01 SouthField EW-17 31567 07/13/98 Active Turned off 9/6/05, replaced by EW-17A SouthField EW-19 31560 07/13/98 Active Turned off 9/6/05, replaced by EW-17A SouthField	1.202-1.	-				
South Plume RW-2 3925 08/27/93 Active South Plume RW-4 3926 08/27/93 Active South Plume RW-4 3927 08/27/93 Active South Plume RW-5 3928 08/27/93 Inactive South Plume RW-6 32308 08/09/98 Active South Plume RW-7 32309 08/09/98 Active SouthField EW-13 31565 07/13/98 Inactive Turned off 9/11/94, not needed SouthField EW-13 31565 07/13/98 Inactive Turned off 9/11/94, not needed SouthField EW-15 31566 07/13/98 Inactive Turned off 12/19/01 SouthField EW-15a 33262 07/26/03 Active Turned off 12/19/01 SouthField EW-17 31567 07/13/98 Active Turned off 9/6/05, replaced by EW-17A SouthField EW-19 31560 07/13/98 Active Turned off 9/6/05, replaced by EW-17A SouthField						
South Plume RW-3 3926 08/27/93 Active South Plume RW-5 3927 08/27/93 Inactive South Plume RW-6 32308 08/09/98 Active South Plume RW-6 32308 08/09/98 Active South Plume RW-7 32309 08/09/98 Active SouthField EW-13 31565 07/13/98 Inactive Turned off 5/22/01 SouthField EW-14 31566 07/13/98 Inactive Turned off 12/19/01 SouthField EW-15a 33262 07/13/98 Inactive Turned off 12/19/01 SouthField EW-17 31567 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-17 31567 07/13/98 Inactive Turned off 9/6/05, replaced by EW-17A SouthField EW-17 31560 07/13/98 Active SouthField EW-21 31560 07/13/98 Active SouthField EW-21 33260 0	South Plume	RW-I	3924	08/27/93	Active	
South Plume RW-4 South Plume RW-5 South Plume RW-6 RW-6 RW-6 South Plume RW-7 RW-6 RW-7 RW-6 RW-7 RW-7 RW-7 RW-7 RW-7 RW-7 RW-7 RW-7	South Plume	RW-2	3925	08/27/93	Active	
South Plume South Plume RW-5 RW-6 3928 32308 08/27/93 08/09/98 Active Turned off 9/11/94, not needed South Plume South Plume RW-7 32309 32309 08/09/98 08/09/98 Active Active SouthField SouthField SouthField EW-15 SouthField EW-15 SouthField EW-17 SouthField EW-17 SouthField EW-17 SouthField EW-17 SouthField EW-17 SouthField EW-17 SouthField EW-18 SouthField EW-20 SouthField EW-21 SouthField EW-21 SouthField EW-21 SouthField EW-21 SouthField EW-21 SouthField EW-21 SouthField EW-23 SouthField EW-24 SouthField EW-25 SouthField EW-25 SouthField EW-26 SouthField EW-27 SouthField EW-28 SouthField EW-29 SouthField EW-29 SouthField EW-20 SouthField EW-21 SouthField EW-23 SouthField EW-24 SouthField EW-25 SouthField EW-26 SouthField EW-30 SouthField EW-30 SouthField EW-30 SouthField EW-31 SouthField EW-30 SouthField EW-31 SouthField EW-32 SouthField EW-33 SouthField EW-30 SouthField EW-31 SouthField EW-32 SouthField EW-33 SouthField EW-30 SouthField EW-31 SouthField EW-32 SouthField EW-33 SouthField EW-34 SouthField EW-35 SouthField EW-30 SouthField EW-30 SouthField EW-31 SouthField EW-32 SouthField EW-33 SouthField EW-34 SouthField EW-35 SouthField EW-30 SouthField EW-30 SouthField EW-31 SouthField EW-32 SouthField EW-33 SouthField EW-34 SouthField EW-35 SouthField EW-36 SouthField EW-37 SouthField EW-38 SouthField EW-39 SouthField EW-30 SouthField EW-30 SouthField EW-31 SouthField EW-32 SouthField EW-33 SouthField EW-34 SouthField EW-35 SouthField EW-30 SouthField EW-30 SouthField EW-31 SouthField EW-32 SouthField EW-31 SouthField EW-32 SouthField EW-31 SouthField EW-32 SouthField EW-31 SouthField EW-31 SouthField EW-31 SouthField EW-32 SouthField EW-31 SouthField EW-31 SouthField EW-31 SouthField EW-31 SouthField EW-31 SouthField EW-31 SouthField EW-32 SouthField EW-31 SouthField EW-32 SouthField EW-31 Sout	South Plume	RW-3	3926	08/27/93	Active	
South Plume South Plume RW-6 RW-7 32309 32308 08/09/98 08/09/98 Active Active Database Active Turned off 5/22/01 SouthField SouthField EW-13 EW-14 31565 31565 07/13/98 07/26/03 Inactive Turned off 12/19/01 Turned off 12/19/01 SouthField SouthField EW-15 EW-15 33262 31566 07/13/98 07/13/98 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 Turned off 9/6/05, replaced by EW-17A SouthField SouthField EW-17 EW-17 33326 09/13/05 09/13/05 09/13/05 09/13/98 00/13/98 00/13/98 00/13/98 Active SouthField Active EW-19 31560 Active 07/13/98 00/13/98 00/13/98 00/13/98 Active SouthField Turned off 9/6/05, replaced by EW-17A SouthField SouthField EW-19 31560 31561 07/13/98 07/21/398 07/29/30 Active SouthField Active EW-21 33266 Turned off 3/13/03, replaced by EW-21A SouthField SouthField EW-21 33267 33247 02/02/00 Active SouthField Active EW-23 33264 Active 07/25/03 Active SouthField Turned off 3/13/03, replaced by EW-21A SouthField EW-23 33267 33247 02/02/00 Active SouthField EW-23 33266 Active 07/25/03 Active SouthField EW-31 33265 Active 07/25/03 Active SouthField EW-31 33265 33266 07/25/03 Active SouthField Turned off 7/1/05. P&Ad WSA EW-28 33063 <td< td=""><td>South Plume</td><td>RW-4</td><td>3927</td><td>08/27/93</td><td>Active</td><td></td></td<>	South Plume	RW-4	3927	08/27/93	Active	
South Plume RW-7 32309 08/09/98 Active SouthField EW-13 31565 07/13/98 Inactive Turned off 5/22/01 SouthField EW-14 31564 07/13/98 Inactive Turned off 12/19/01 SouthField EW-15 31566 07/13/98 Inactive Turned off 8/7/98, replaced by EW-15A SouthField EW-16 31563 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-17 31567 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-17 31567 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-17a 31550 09/13/95 Active Active SouthField EW-18 31550 09/13/98 Active Turned off 3/13/03, replaced by EW-21A SouthField EW-21 31562 07/13/98 Active Turned off 3/13/03, replaced by EW-21A SouthField EW-21 32246 07/20/20 Active Active	South Plume	RW-5	3928	08/27/93	Inactive	Turned off 9/11/94, not needed
SouthField EW-13 31565 07/13/98 Inactive Turned off 5/22/01 Turned off 12/19/01 SouthField EW-15 31566 07/13/98 Inactive Turned off 12/19/01 Turned off 8/7/98, replaced by EW-15A SouthField EW-15a 33262 07/26/03 Active Turned off 8/7/98, replaced by EW-15A SouthField EW-16 31563 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-17a 33560 09/13/05 Active Turned off 9/6/05, replaced by EW-17A SouthField EW-17a 33560 09/13/98 Active Active SouthField EW-18 31550 09/13/98 Active Active SouthField EW-20 31561 07/13/98 Inactive Turned off 3/13/03, replaced by EW-21A SouthField EW-21 31562 07/13/98 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-33	South Plume	RW-6	32308	08/09/98	Active	
SouthField EW-14 BW-15 BOUTHField 31564 BW-15 BW-16 BW-16 BW-16 BW-16 BW-16 BW-16 BW-16 BW-16 BW-16 BW-17	South Plume	RW-7	32309	08/09/98	Active	
SouthField EW-15 31566 07/13/98 Inactive Turned off 8/7/98, replaced by EW-15A SouthField EW-15 33262 07/26/03 Active SouthField EW-16 31563 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-17 31567 07/13/98 Inactive Turned off 9/6/05, replaced by EW-17A SouthField EW-18 31550 07/13/98 Active SouthField EW-19 31560 07/13/98 Active SouthField EW-20 31561 07/13/98 Active SouthField EW-21 31562 07/13/98 Inactive Turned off 3/13/03, replaced by EW-21A SouthField EW-21 31562 07/13/98 Inactive Turned off 3/13/03, replaced by EW-21A SouthField EW-21 31562 07/13/98 Inactive Turned off 3/13/03, replaced by EW-21A SouthField EW-23 32447 02/02/00 Active SouthField EW-23 33061 05/07/25/03 A	SouthField	EW-13	31565	07/13/98	Inactive	Turned off 5/22/01
SouthField EW-15a 33262 07/26/03 Active Turned off 12/19/02, Converted to IW16 SouthField EW-16 31563 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-17 31567 07/13/98 Lative Turned off 9/6/05, replaced by EW-17A SouthField EW-18 31550 09/13/98 Active Active SouthField EW-19 31560 07/13/98 Active Active SouthField EW-20 31561 07/13/98 Active Turned off 3/13/03, replaced by EW-21A SouthField EW-21A 33298 07/29/03 Active Active SouthField EW-21A 33298 07/29/03 Active SouthField EW-21 32476 07/13/98 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 33447 02/02/00 Active SouthField EW-31 33265 07/25/03 Active SouthFi	SouthField	EW-14	31564	07/13/98	Inactive	Turned off 12/19/01
SouthField EW-16 31563 07/13/98 Inactive Turned off 12/19/02, Converted to IW16 SouthField EW-17 31567 07/13/98 Inactive Turned off 9/6/05, replaced by EW-17A SouthField EW-18 31550 09/13/05 Active SouthField EW-19 31560 07/13/98 Active SouthField EW-20 31561 07/13/98 Active SouthField EW-21 31562 07/13/98 Inactive Turned off 3/13/03, replaced by EW-21A SouthField EW-21A 33298 07/29/03 Active SouthField EW-21A 33298 07/29/03 Active SouthField EW-23 32247 02/02/00 Active Active SouthField EW-23 33244 02/02/00 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active <	SouthField	EW-15	31566	07/13/98	Inactive	Turned off 8/7/98, replaced by EW-15A
SouthField EW-17 31567 07/13/98 Inactive Turned off 9/6/05, replaced by EW-17A SouthField EW-18 31550 09/13/05 Active SouthField EW-19 31550 07/13/98 Active SouthField EW-20 31561 07/13/98 Active SouthField EW-21 31562 07/13/98 Inactive SouthField EW-21A 33298 07/29/03 Active SouthField EW-21A 33298 07/29/03 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-23 33244 02/02/00 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-27 33062 05/08/02 Active <td>SouthField</td> <td>EW-15a</td> <td>33262</td> <td>07/26/03</td> <td>Active</td> <td></td>	SouthField	EW-15a	33262	07/26/03	Active	
SouthField EW-17a 33326 09/13/05 Active SouthField EW-18 31550 07/13/98 Active SouthField EW-19 31560 07/13/98 Active SouthField EW-20 31561 07/13/98 Active SouthField EW-21 31562 07/13/98 Inactive SouthField EW-21A 33298 07/29/03 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-24 32466 02/02/00 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28	SouthField	EW-16	31563	07/13/98	Inactive	Turned off 12/19/02, Converted to IW16
SouthField EW-18 31550 07/13/98 Active SouthField EW-19 31560 07/13/98 Active SouthField EW-20 31561 07/13/98 Active SouthField EW-21 31562 07/13/98 Inactive SouthField EW-21A 33298 07/29/03 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-23 33244 02/02/00 Active SouthField EW-25 33061 05/07/02 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-33	SouthField	EW-17	31567	07/13/98	Inactive	Turned off 9/6/05, replaced by EW-17A
SouthField EW-19 31560 07/13/98 Active SouthField EW-20 31561 07/13/98 Active SouthField EW-21 31562 07/13/98 Inactive Turned off 3/13/03, replaced by EW-21A SouthField EW-21A 33298 07/29/03 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-24 32446 02/02/00 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-32 33062 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-33 33330 Spring 2006 Active	SouthField	EW-17a	33326	09/13/05	Active	•
SouthField EW-20 31561 07/13/98 Active SouthField EW-21 31562 07/13/98 Inactive Turned off 3/13/03, replaced by EW-21A SouthField EW-21A 33298 07/29/03 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-24 32446 02/02/00 Active SouthField EW-25 33061 05/07/02 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-28 33063 05/08/02 Active WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8A 33253 11/07/02 Inactive	SouthField	EW-18	31550	07/13/98	Active	
SouthField EW-21 31562 07/13/98 Inactive Turned off 3/13/03, replaced by EW-21A SouthField EW-21A 33298 07/29/03 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-24 32446 02/02/00 Active SouthField EW-25 33061 05/07/02 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-33 33330 Spring 2006 Active WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8A 33253 11/07/02 Inactive <td< td=""><td>SouthField</td><td>EW-19</td><td>31560</td><td>07/13/98</td><td>Active</td><td></td></td<>	SouthField	EW-19	31560	07/13/98	Active	
SouthField EW-21A 33298 07/29/03 Active SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-24 32446 02/02/00 Active SouthField EW-25 33061 05/07/02 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive WSA EW-33 33330 Spring 2006 Active WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 9/25/04 Re-Injec	SouthField	EW-20	31561	07/13/98	Active	
SouthField EW-22 32276 07/13/98 Active SouthField EW-23 32447 02/02/00 Active SouthField EW-24 32446 02/02/00 Active SouthField EW-25 33061 05/07/02 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active WSA EW-32 33266 07/25/03 Active WSA EW-32 33062 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Active WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 7/1/05. P&Ad Re-Injection IW-8 22107 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive <td>SouthField</td> <td>EW-21</td> <td>31562</td> <td>07/13/98</td> <td>Inactive</td> <td>Turned off 3/13/03, replaced by EW-21A</td>	SouthField	EW-21	31562	07/13/98	Inactive	Turned off 3/13/03, replaced by EW-21A
SouthField EW-23 32447 02/02/00 Active SouthField EW-24 32446 02/02/00 Active SouthField EW-25 33061 05/07/02 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33330 Spring 2006 Active We-Injection IW-8 22107 09/02/98 Inactive Turned off 7/1/05. P&Ad Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection	SouthField	EW-21A	33298	07/29/03	Active	
SouthField EW-24 32446 02/02/00 Active SouthField EW-25 33061 05/07/02 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 7/1/05. P&Ad Re-Injection IW-8 22107 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 <	SouthField	EW-22	32276	07/13/98	Active	
SouthField EW-25 33061 05/07/02 Active SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 7/1/05. P&Ad Re-Injection IW-8 22107 09/02/98 Inactive Turned off 12/31/01 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive <t< td=""><td>SouthField</td><td>EW-23</td><td>32447</td><td>02/02/00</td><td>Active</td><td></td></t<>	SouthField	EW-23	32447	02/02/00	Active	
SouthField EW-30 33264 07/25/03 Active SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 7/1/05. P&Ad Re-Injection IW-8 22107 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 <td>SouthField</td> <td>EW-24</td> <td>32446</td> <td>02/02/00</td> <td>Active</td> <td></td>	SouthField	EW-24	32446	02/02/00	Active	
SouthField EW-31 33265 07/25/03 Active SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 12/31/01 Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 <	SouthField	EW-25	33061	05/07/02	Active	
SouthField EW-32 33266 07/25/03 Active WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33030 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 12/31/01 Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 3/1/02 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injectio	SouthField	EW-30	33264	07/25/03	Active	
WSA EW-26 32761 05/08/02 Active WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 12/31/01 Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04	SouthField	EW-31	33265	07/25/03	Active	
WSA EW-27 33062 05/08/02 Active WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 12/31/01 Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inac	SouthField	EW-32	33266	07/25/03	Active	
WSA EW-28 33063 05/08/02 Inactive Turned off 7/1/05. P&Ad WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 12/31/01 Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	WSA	EW-26	32761	05/08/02	Active	
WSA EW-33 33330 Spring 2006 Active Re-Injection IW-8 22107 09/02/98 Inactive Turned off 12/31/01 Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	WSA	EW-27	33062	05/08/02	Active	
Re-Injection IW-8 22107 09/02/98 Inactive Turned off 12/31/01 Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 3/1/02 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	WSA	EW-28	33063	05/08/02	Inactive	Turned off 7/1/05. P&Ad
Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 3/1/02 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	WSA	EW-33	33330	Spring 2006	Active	
Re-Injection IW-8A 33253 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-9 22108 09/02/98 Inactive Turned off 3/1/02 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	Re-Injection	IW-8	22107	09/02/98	Inactive	Turned off 12/31/01
Re-Injection IW-9 22108 09/02/98 Inactive Turned off 3/1/02 Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	Re-Injection	IW-8A	33253	11/07/02	Inactive	Turned off 9/25/04
Re-Injection IW-9A 33254 11/07/02 Inactive Turned off 9/25/04 Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	*	IW-9	22108	09/02/98	Inactive	Turned off 3/1/02
Re-Injection IW-10 22109 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	-		33254	11/07/02	Inactive	Turned off 9/25/04
Re-Injection IW-10A 33255 5/22/03 Inactive Turned off 9/25/04 Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	_	IW-10	22109	09/02/98	Inactive	Turned off 9/25/04
Re-Injection IW-11 22240 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	_	IW-10A	33255	5/22/03	Inactive	Turned off 9/25/04
Re-Injection IW-12 22111 09/02/98 Inactive Turned off 9/25/04 Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	-					
Re-Injection IW-16 31563 07/27/03 Inactive Turned off 9/25/04 Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04	-					
Re-Injection IW-29 33263 07/27/03 Inactive Turned off 9/25/04						
·	•					
	Re-Injection	Inj. Pond				

and a february environment

- Extraction Well
- OSDF Valve House
- **1** Waste Storage Area Module
- 2 CAWWT Facility
- Stormwater Retention Basin Valve House
- On-Site Disposal Facility
- **6** Permanent Lift Station
- 6 Parshall Flume
- Underground Outfall Line to the Great Miami River
- **8** South Field Valve House
- South Field Module
- **10** South Plume Module



CAWWT Facility



South Plume Module Off-Site Wells



FIGURE 3-2

ARWWT TIMELINE

Aquifer Restoration		Wastewater Treatment
-	— 1952	STP
	— 1986	BSL / HNT
	— 1988	SWRB
	— 1992	IAWWT Facility
South Plume Extraction Wells 19	93—	·
	— 1994	SPIT Facility
	— 1995	AWWT Phases I/II
	— 1996	SDF
Injection Demonstration Module 19	98——1998	AWWT Resin Regeneration System
South Plume Optimization Module		New STP Operational
South Field Extraction Module (Phase I)		AWWT Expansion
	— 1999	BSL Pump and Piping Modifications / Sludge Removal System
Waste Storage Area Module (Phase I) 20	02	The Post of the Po
	03—	
Shut down well-based reinjection 20		Shut down AWWT Expansion for conversion to CAWWT – 9/04
	— 2005	Re-route to Leachate to SWRB – 3/05
		Re-route WSA Storm Water to SWRB – 3/05
		BSL is shutdown for D&D and Excavation – 3/05
		Begin full-scale operation of CAWWT – 3/05
		Shut down Sewage Treatment Plant for D&D and Excavation – 3/05
		Shut down SDF for D&D and excavation – 3/05
		Shutdown AWWT Phases I & II for selective D&D and excavation – 3-4/05
		Shut down SPIT/IAWWT for D&D and excavation – 7/05
		Re-route WSA Storm Water to CAWWT – 10/05
		Shutdown West SWRB for D&D and excavation – 10/05
Waste Storage Area Module (Phase II) 20	—2006	Shutdown East SWRB for D&D and excavation – 2/06
Pilot Plant Replacement Well		Re-route of OSDF leachate/storm water directly to CAWWT – 2/06
		CAWWT Backwash Basin Operational – 2/06
		OSDF capped sufficiently such that OSDF storm water can be routed to free release – 2006
		Transfer of site from DOE-EM to DOE-LM
	— 2007	Groundwater Treatment to Meet Discharge Limits Projected to End Between 2007 and 2011
	— 2011	
	15—	
South Plume Module – Certified Clean 20	18—	
South Field Module – Stop P&T Operations* 20	22—	
Waste Storage Area – Stop P&T Operations* 20	23—	Note: Certified clean dates assume best case (3.25 years)
	25—	
South Field Module - Certified Clean		
South Field Module – Remove Infrastructure 20	26—	* Stop P&T operations dates are based on modeling reported
Waste Storage Area - Certified Clean		in the WSA (Phase II) design report (Approach C).
Waste Storage Area – Remove Infrastructure		
	31—	

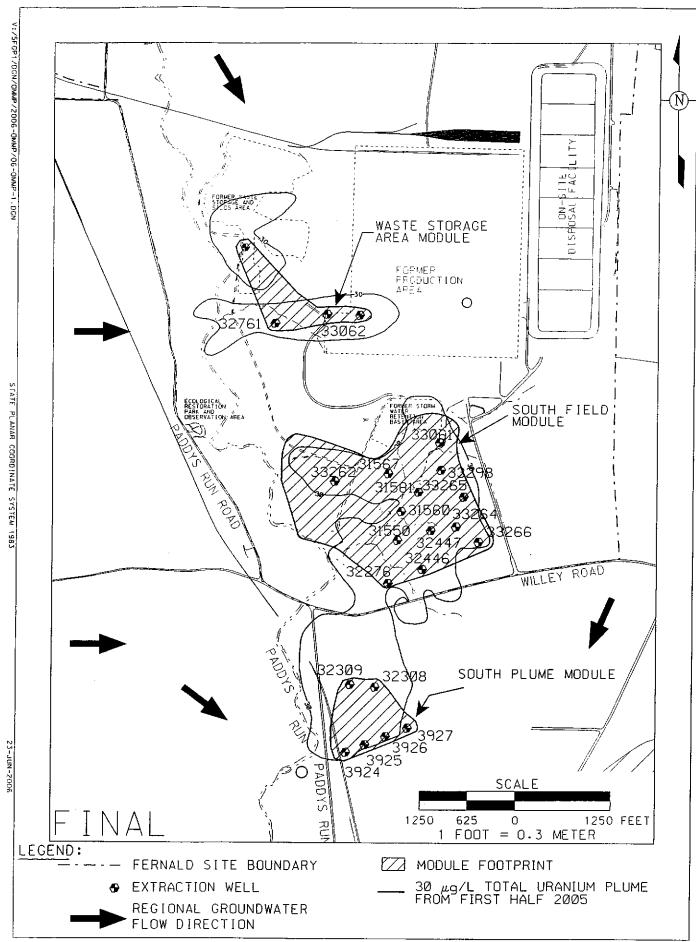


FIGURE 3-3. EXTRACTION WELLS FOR THE GROUNDWATER REMEDY

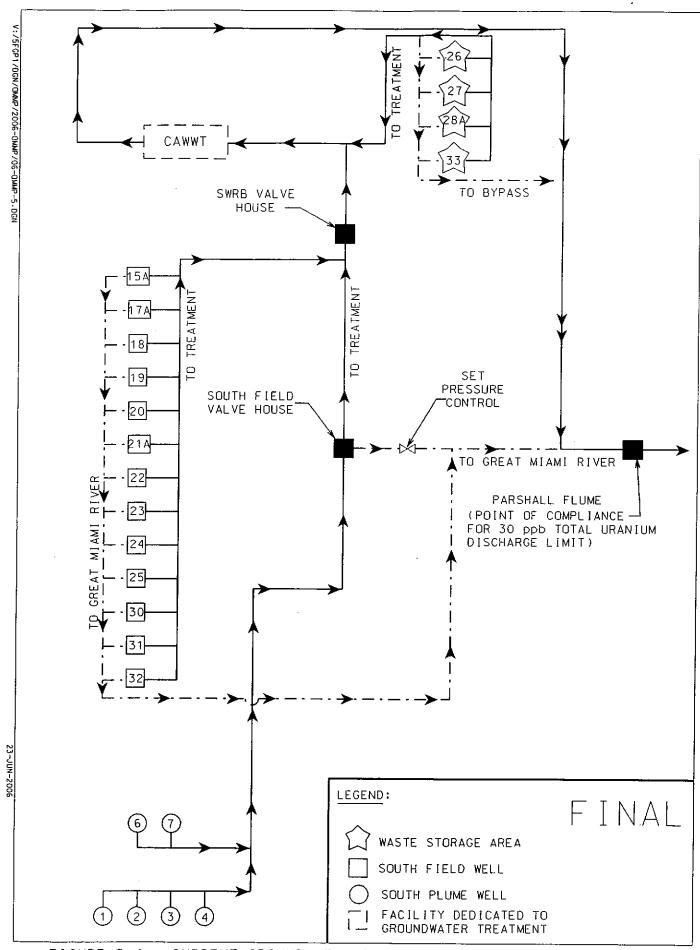


FIGURE 3-4. CURRENT GROUNDWATER REMEDIATION/TREATMENT SCHEMATIC

FIGURE 3-5 GROUNDWATER CERTIFICATION PROCESS AND STAGES

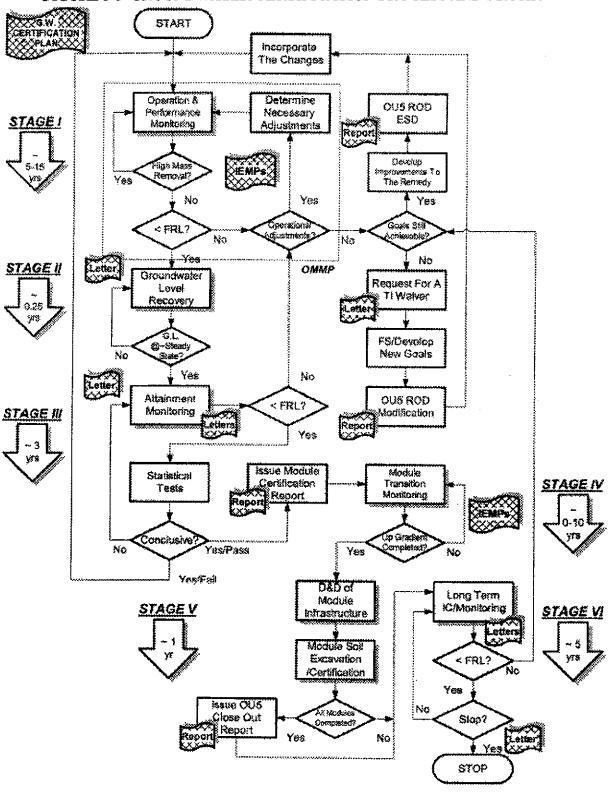


Figure 3-6 CAWWT Process Flow Diagram

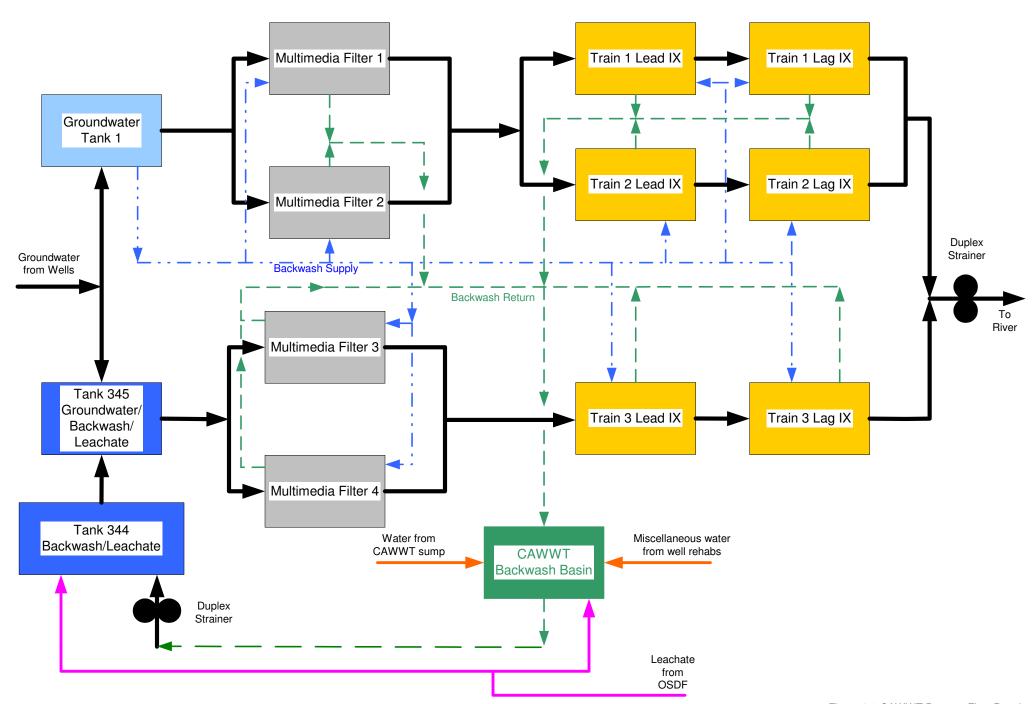


Figure 3-7 Monthly Average Uranium Concentration in the Effluent to the Great Miami River 30 ppb limit in effect Phase II clarifier Eluate from regen. & STP upset Storm Water 20 ppb limit in effect January 1998


35

30

25

Uranium Concentration (ug/L)



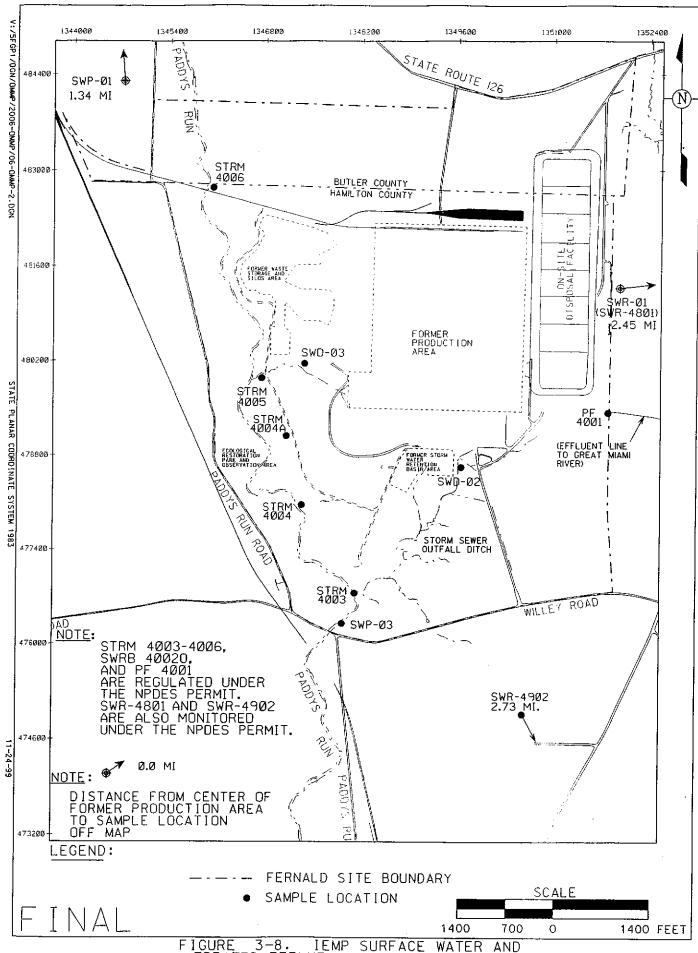

IGURE 3-8. IEMP SURFACE WATER AND TREATED EFFLUENT SAMPLE LOCATIONS

4.0 PROJECTED FLOWS

This section addresses the latest understanding of flows for groundwater and OSDF leachate.

4.1 GROUNDWATER

Extracted groundwater is the only wastewater flow requiring treatment. Groundwater extraction rates can be controlled. Groundwater flows are defined such that discharge limits at the Parshall Flume, and capture of the 30 μg/L uranium plume are achieved. The objective is to pump as aggressively as possible, without exceeding discharge limits. The individual groundwater remediation modules currently comprising the aquifer remedy are presented in Section 3.1. Figure 3-3 depicts the locations of all existing extraction wells. Table 4-1 provides the target extraction rate schedule for each of the wells currently operating. The combined modeled pumping rate is approximately 4,775 gpm.

Throughout the duration of groundwater remediation the pumping rates may be modified within system design and operational constraints, as necessary. These rate modifications will be made to maintain, to the degree possible, the aquifer restoration objectives outlined in the remedy design. An operational rate of 10% over the modeled pumping rates is being targeted to provide for anticipated and unanticipated downtime.

4.1.1 On-Site Disposal Facility (OSDF) Leachate

Leachate flow from the OSDF Project is estimated to be approximately 1 to 5 gallons per minute initially. Based on leachate yield from the Cells 1, and 2, which have been capped for more than 2 years, the total leachate flow from the entire facility is anticipated to decline to less than 1 gallon per minute by 2008. The leachate collects in the Permanent Lift Station (PLS) pump sump and from there is pumped to CAWWT for treatment.

TABLE 4-1
TARGET EXTRACTION RATE SCHEDULE

System ID	Location	Ops. Well ID	SED Well ID	Target Extraction Rates (gpm) * to 04/01/15	Target Extraction Rates (gpm) 4/01/15 to End
I	Waste Pits	WSA-1	32761	300	500
I	Waste Pits	WSA-2	33062	200	200
1	Waste Pits	WSA-4	33334	200	200
I	Waste Pits	WSA-5	33330	300	300
	System Totals	Pumped		1000	1200
II	South Field	EW-15a	33262	200	300
II	South Field	EW-17	31567	175	175
H	South Field	EW-18	31550	100	100
IJ	South Field	EW-19	31560	100	100
II	South Field	EW-20	31561	100	400
II	South Field	EW-21a	33298	200	300
II	South Field	EW-22	32276	300	400
11	South Field	EW-23	32447	300	400
Ц	South Field	EW-24	32446	300	300
II	South Field	EW-25	33061	100	100
II	South Field	EW-30	33264	200	400
II	South Field	EW-31	33265	300	400
П	South Field	EW-32	33266	200	200
	System Totals	Pumped		2575	3575
IV	South Plume	RW-1	3924	200	0
IV	South Plume	RW-2	3925	200	0
IV	South Plume	RW-3	3926	200	0
IV	South Plume	RW-4	3927	200	0
IV	South Plume	RW-6	32308	200	0
	South Plume	RW-7	32309	200	0
	System Totals	Pumped		1200	0

 $^{^{\}star}$ Beginning when site transfers from DOE-EM to DOE-LM

المستوالية التواسي علم الأوار والتواسية

5.0 OPERATIONS PLAN

This section contains the operations philosophy, treatment priorities, hierarchy of decisions, management and flow of operations information, and management of treatment residuals necessary to successfully operate the groundwater extraction and treatment systems in order to achieve regulatory requirements and commitments.

5.1 WASTEWATER TREATMENT OPERATIONS PHILOSOPHY

The primary goals of wastewater treatment operations and maintenance are to: 1) meet effluent discharge requirements; 2) provide sufficient treatment capacity such that the desired groundwater pumping rates can be maintained; and 3) provide for leachate treatment. In keeping with the principles of as low as reasonably achievable, correct decisions in applying treatment are required to maximize the quantity of uranium removed from wastewater prior to its discharge to the Great Miami River. Maximizing uranium removal should result in compliance uranium discharge limits. Other regulatory discharge requirements, such as NPDES, must also be met. Influent streams to treatment and effluent streams from treatment as well as other process control sampling around specific unit operations (e.g., ion exchangers,) is completed for uranium and other appropriate constituents as necessary to provide information needed to help ensure that the goals are met. Sampling under the NPDES permit and the IEMP is performed to verify requirements and effluent limits for discharges to the Great Miami River are met.

5.2 <u>CAWWT OPERATION</u>

As discussed in Section 3, the only remaining treatment system is CAWWT. The effluent from this system, along with bypassed (untreated) groundwater, combine at the Parshall Flume to form the Fernald site's regulated discharge to the Great Miami River.

The priority for treatment will always be OSDF leachate and the extraction wells with the highest uranium concentrations. Groundwater sent to treatment typically contains a uranium concentration of 60 to 70 ppb. Groundwater is fed to two treatment systems at CAWWT. The 1200 gpm system treats only groundwater. The 600-gpm system treats groundwater, leachate from OSDF and water from the CAWWT Backwash Basin.

The CAWWT Backwash Basin collects backwash from all CAWWT ion exchange vessels and multimedia filters, water from the CAWWT Sump and miscellaneous water from well rehabilitations. Water from the Basin will be pumped to the 600 gpm treatment system at a flow rate adequate to ensure that the Basin level does not reach five feet. Groundwater flow to the 600 gpm system is reduced as

necessary to maintain a low level in the Basin. The Basin will maintain at least six inches of freeboard at all times.

Shift supervision is provided 12 hours per day, seven days per week, 365 days per year. As the supervisor of all operations and maintenance activities that occur on a particular shift, the shift supervisors are responsible for ensuring that treatment and monitoring equipment is operated, maintained and repaired as necessary so that maximum prioritized treatment throughput is achieved at all times. Operations and maintenance are performed in accordance with all appropriate standard operating procedures, standards, and specifications. Additionally, process engineering support personnel are on-call to provide assistance in problem solving.

5.2.1 Ion Exchange Vessel Rotation

The CAWWT ion exchange system has trains of two ion exchange vessels operating in series, lead and lag. When the ion exchange resin in both vessels is new, the majority of uranium is removed in the lead vessel. As the lead vessel becomes loaded with uranium, more passes through into the lag vessel. As the lag vessel becomes loaded, more uranium passes into the discharge stream. When the uranium concentration in the discharge from a particular ion exchange train causes the uranium concentration at the Parshall Flume to approach or exceed 30 ppb, the resin will be removed from the lead vessel and replaced with new resin. The lag vessel is moved into lead and the vessel containing new resin is place in lag

5.3 GROUNDWATER TREATMENT

CAWWT provides approximately 1800 gpm treatment for groundwater. Wells are pumped to treatment or bypass as described in the next section. The setpoints at which the wells are pumped are typically set to approximately ten percent more than the target setpoint in the groundwater remedy to account for downtime.

5.3.1 Groundwater Treatment Prioritization vs. Bypassing

Treatment of groundwater well discharges are prioritized in order of uranium concentration, with the highest uranium concentration wells routed to treatment until all available treatment capacity is utilized. Remaining well discharges are bypassed around treatment to the Parshall Flume. As shown schematically in Figure 3-4, treatment/bypass decisions for the Southfield extraction wells are made on a well-by-well basis. The existing four South Plume off-property, leading-edge wells combined with the two wells of the South Plume Optimization Project are routed as a group either for treatment, full bypass, or partial bypass since piping does not exist for well-by-well treatment/bypass decision. The off-property South Plume wells are typically routed directly to bypass at the South Field Valve House since their combined uranium concentration is very near or less than 30 ppb uranium.

5.4 WELL FIELD OPERATIONAL OBJECTIVES

Several objectives must be considered when well field operational decisions are made. These objectives are listed in Table 5-1 along with the anticipated actions required to achieve each objective. At times the objectives conflict; therefore, operational decisions are generally made by Aquifer Restoration/Wastewater Project management. These discussions regarding operational decisions are held on an as-needed basis. Decisions from these meetings that affect wellfield operations are communicated to the EPA and OEPA in the IEMP reports. Changes in groundwater restoration well pumping set points are transmitted to shift supervisors by the ARWWP manager.

In addition to the objectives listed in Table 5-1, an annual measure of uranium concentration rebound will be conducted each year. Uranium contamination bound to aquifer sediments in the unsaturated portion of the Great Miami Aquifer has been identified under some source areas at the site. Uranium contamination bound to unsaturated aquifer sediments will remain bound unless water levels rise and saturate the sediments allowing the contamination to dissolve into the groundwater.

Annual exercises are being planned to shut down all extraction wells (with the exception of the 4 leading edge South Plume Recovery Wells) from June 15 to July 15 each year to allow water levels within the aquifer to rise. Based on evaluation of aquifer water levels collected since 1988, during June and July seasonal water levels are usually at their highest level. Shutting down the extraction wells during the same time period that seasonal water levels are high will maximize the saturation of as much of the aquifer sediments as possible. Water levels will be measured at key locations (by hand and downhole transducer/data logger) before, during and after the shutdown to record the resulting water level change. Uranium concentration in the pumped groundwater immediately after the wells are re-started will be compared to pre-shutdown concentrations to determine the amount of concentration re-bound that occurred. Shut down times are subject to change based on results of the exercise.

The well-field downtime period will also be utilized to conduct well field and water treatment system maintenance.

5.5 OPERATIONAL MAINTENANCE PRIORITIES

Maintaining the treatment facilities on line includes ensuring that all equipment is operating properly, that adequate personnel are assigned to operate the treatment systems safely, and that the combined treatment and bypassing systems are removing uranium to below 30 ppb as measured at the Parshall Flume. Following is a list of operational maintenance priorities in their order of importance

- Keep the Parshall Flume discharge point and sampling system on line. If the discharge
 monitoring system were to become non-operational, discharge monitoring of effluent to the river
 from the Fernald site would have to be collected manually. The sampling system must be
 operational so that accurate reports of uranium and NPDES contaminant levels can be made.
- Keep the CAWWT treatment trains operating at full capacity.

- Keep South Plume Wells 1-4 operating at desired setpoints.
- Keep all extraction wells operating at the desired setpoints.
- More specific details of managing equipment operation and maintenance are contained in Section 6.

5.6 OPERATIONS CONTROLLING DOCUMENTS

Operations at the wastewater treatment facilities are controlled directly by Standing Orders and Standard Operating Procedures contained in the Legacy Management Fernald Operating Procedures, Revision 0 (DOE 2006c). Standing Orders translate the DOE Orders, conduct of operations principles, guidelines, and procedures into performance requirements for personnel involved in operating the wastewater treatment facilities. The Standing Orders were written to ensure that all operations are conducted in full conformance with DOE conduct of operations requirements.

A more extensive discussion of Standard Operating Procedures and Standing Orders is contained in Section 6.1.2. Standing Orders and Standard Operating Procedures implement the requirements of this plan. The OMMP is not intended to replace Standing Orders or Standard Operating Procedures.

5.7 MANAGEMENT AND FLOW OF OPERATIONS INFORMATION

Samples are taken from each of the CAWWT trains on a regular basis to ensure uranium is still being removed by the resin. The results of the sample analysis are reviewed daily by project personnel to review system performance and determine if any of the treatment system ion exchange vessels need to be removed from service for resin replacement.

The project issues weekly operations reports that summarize flow rates and flow totals as well as uranium concentrations from CAWWT and the wells. Information on required well pumping rates is communicated from the manager of the Aquifer Restoration/Wastewater Project to the operations personnel via the operating orders, as specified in the Standing Orders.

5.8 MANAGEMENT OF TREATMENT RESIDUALS

Treatment residuals consist of exhausted ion exchange resin and used multimedia filter media. These materials will be disposed of offsite using a subcontractor qualified to handle radioactive materials.

TABLE 5-1

WELL FIELD OPERATIONAL OBJECTIVES

Objectives Actions Required Operate individual wells within Operate well pumps and motors per manufacturer recommendations constraints imposed by system design and equipment. Key constraints include: Operate extraction well systems within design constraints · Pumping equipment is limited to a range of flows that will dictate the flexibility of extraction rates for individual wells · Hydraulic capacity of the piping limits extraction rates · Control range of flow control valves and variable frequency drives for pump motors bound the range of extraction rates for individual wells Capacity of existing electrical service to each well Average entrance velocity of water moving into the screen should not exceed 0.1 ft/sec Perform necessary equipment/well Per OMMP, Section 6 maintenance in accordance with established schedules. Maintain compliance with the discharge Monitor discharge concentrations limits of 30 µg/L monthly average Modify well set points as necessary to maintain compliance with uranium concentration and 600 lbs/yr for discharge limits. the combined site water discharged to the Evaluate well set points and treatment routing monthly Great Miami River. Use flow weighted average concentration calculations to predict how changes to set points and routing will effect discharge concentrations. Compare predictions with actual measurements to evaluate if/how predictions can be improved. Maintain well set points to the degree possible Minimize impact to the Paddys Run Road Pumping from Recovery Well 3924 (RW-1) should not exceed Site plume. 300 gpm. Pumping from Recovery Well 3925 (RW-2) should not exceed 300 gpm (if Well 3924 is pumping) and 400 gpm (if Well 3924 is not pumping). Pumping from Recovery Well 3926 (RW-3) should not exceed 500 gpm if either Well 3924 or Well 3925 goes down. If the actual capture zone differs significantly from that defined via previous modeling it may be determined that the above-noted pumping rates require modification in order to maintain this objective. Required modifications will be made based on

additional modeling projections and verified based on field data.

TABLE 5-1 (Continued)

Objectives

Actions Required

Maintain capture of the 30 μ g/L uranium plume along the southern Administrative Boundary.

 The following pumping rates for each South Plume Well provides for the capture (within system constraints) of the uranium plume along the administrative boundary:

> Recovery Well 3924 at 200 gpm Recovery Well 3925 at 200 gpm Recovery Well 3926 at 200 gpm Recovery Well 3927 at 200 gpm

- Adjust the pumping rates of the remaining operable wells in the South Plume module to maintain capture along the administrative boundary when: 1) any single South Plume Module well outage for one week or more occurs; or 2) when multiple well outages for three days or more occur
- If the actual capture zone differs significantly from that defined via previous modeling it may be determined that the above-noted pumping rates require modification in order to maintain this objective. Required modifications will be made based on additional modeling projections and verified based on field data.

Maintain hydraulic capture of the remaining portions of the 30 μ g/L uranium plume (within areas of active modules).

- Establish pumping rates based on model predictions of required pumping rates to maintain a desired area of capture.
- Determine the actual area of capture created when the wells are operating at the modeled rates based on groundwater elevation contour maps derived from field measurements.
- Adjust pumping rates within system design and operational constraints, if warranted, when the actual area of capture is not consistent with the modeled area of capture. This will be done in an effort to establish an area of capture consistent with the desired area of capture, as modeled.

Minimize duration of clean-up time for off-property portion of the 30 μ g/L uranium plume.

- Give priority to keeping South Plume and South Plume Optimization Wells online when other wells have to be shut down
- Maximize pumping rates within the following constraints/considerations: system design and equipment, hydraulic capacity of the aquifer, regulatory limits, interaction with other modules and remedy performance.

Minimize duration of cleanup time for on-property portions of the uranium plume.

 Maximize pumping rates within the following constraints/considerations: system design and equipment, hydraulic capacity of the aquifer, regulatory limits, interaction with other modules

Minimize migration of on-property portion of the plume to off-property areas.

 Balance pumping from the South Field Extraction and South Plume Modules such that the stagnation zone is at or south of Willey Road.

Minimize drawdown in off-property areas.

 Do not exceed 110% of the points defined in Table 4-1 unless directed by Aquifer Restoration/Wastewater Project management

6.0 OPERATIONS PERFORMANCE MONITORING AND MAINTENANCE

This section describes the general methods, guidelines, and practices used in managing equipment operation and maintenance and presents planned maintenance and monitoring requirements for the groundwater restoration wells to support successful long-term operation of the groundwater restoration system.

Managing equipment operation and maintenance in the context of this document includes not only routine control panel monitoring and repair work, but also the preventive, predictive, and proactive actions used to maximize equipment operating efficiency and capacities. This section presents some of the management systems that will help to assure that the Operable Unit 5 Record of Decision requirements continue to be met, describes the key parameters used to monitor the performance of the groundwater and wastewater facilities, and describes the principal features and maintenance needs of the overall operation.

The treatment system and restoration well system performance parameters and maintenance requirements have unique differences. The treatment system is designed and built with many redundant features and equipment to reduce potential downtime (e.g., installed spare pumps and lead-lag ion exchange units). Those features are not economically practical for the well systems. The equipment in the treatment systems has more easily discernible indicators of equipment condition and is more easily accessed for monitoring by operating personnel walk-through than the underground well system. The methods used to measure the equipment condition and the specific measurable goals for the two systems also are different.

The activities described within this section also provide the basis for providing routine maintenance of the extraction wells comprising the various modules of the system and for monitoring system performance to determine if more extensive maintenance activities are required. Regularly scheduled maintenance of components of the restoration well system is required so that the difficulties associated with continuous operation will be minimized and thus manageable with the resulting system's online time maximized. Continuous operation of the well system, within practical limitations, is required to maintain groundwater restoration objectives at the Fernald site.

This plan contains monitoring and maintenance activities, and frequencies thereof, based on current projections. The need for and frequency of these activities may change based on future experience gained through the operation, maintenance, and monitoring of the extraction wells that are currently operating. Parameter monitoring frequency may change as well. This plan will be revised as necessary during the life of the groundwater restoration process.

6.1 MANAGEMENT SYSTEMS

6.1.1 Maintenance and Support

A qualified subcontractor under the direction of LM personnel will provide maintenance for the well field and treatment system. Preventative maintenance will be performed on the schedule recommended by the equipment manufacturer.

The technical staff directly support facility operation and maintenance. The technical staff work together to resolve issues and improve operations. They also provide troubleshooting and technical assistance to the day-to-day operations and maintenance groups.

The facilities consist of standard high capacity filter-packed water wells and conventional water and wastewater treatment unit processes that are typical for the industry. It is expected to continue to have good reliability and has well-documented maintenance guidelines. Routine maintenance practices, as documented by the original equipment manufacturer's maintenance manuals, have been used to provide the basis for maintenance procedures and practices. Maintenance feedback and component manufacturer suggestions have been used to develop a spare parts list and stock inventories of the most frequently used parts. The availability of spare parts will assist in minimizing downtimes associated with all maintenance activities.

6.1.2 Operations

Operating personnel play an important role in maximizing equipment operating efficiency and capacity. One significant duty of the facility operating personnel is to identify and report existing and potential future equipment problems. Operating personnel perform routine scheduled checks, inspections, and walk-throughs of the facilities and systems. Potential problems and maintenance needs are reported to supervision and maintenance work orders are initiated. Operating personnel maintain shift logbooks that document activities and specific actions taken during each shift. Information in the logbooks is used as the basis for transfer of duty from one shift to the next. The logbooks are kept as a historical record of operational activities. Management and technical staff periodically review the logbooks and roundsheets as additional assurance that the systems are being effectively operated.

6.1.2.1 Process Control

Facilities are staffed by operating personnel 12 hours per day, seven days per week, 365 days per year. The operating personnel at CAWWT monitor the process using a computerized control system located in the control room. The control system receives input from process meters (e.g., tank level and process flow meters) and from devices that indicate equipment status (e.g., valve position limit switches and motor run relays). The control system outputs control signals to regulate the process (e.g., control valve positioning and motor start/stop control). The control system uses desktop-style computer equipment (monitors, keyboards, and pointing devices) to provide a graphic human-machine interface (HMI) for the process monitoring and control. The control system HMI includes various process graphics screens depicting portions of the treatment system in piping and instrumentation diagram format and providing real time process measurements and information. The control system has graphic process trending capabilities, process alert and alarm management, and an historical database of all operating personnel input and process alert/alarms. The control system also provides an interface with all well systems to provide enhanced real time monitoring and remote controls. The operating personnel at CAWWT also access process and equipment information by making "walking rounds" of all equipment in the process.

6.1.2.2 Standard Operating Procedures

Each operation is performed in accordance with approved Standard Operating Procedures that are developed by the technical staff with the assistance of operations personnel. Standard Operating Procedures can be found in the Legacy Management Fernald Operating Procedures, Revision 0 (DOE 2006c). The Standard Operating Procedures are reviewed periodically and revised as necessary for the safe and consistent operation of treatment processes.

Standard Operating Procedures provide step-by-step instructions for performing wastewater treatment operations activities. They also contain health and safety precautions that must be followed while performing the steps contained in the procedure. The procedures are written from the perspective of the operating personnel who will be performing the steps.

Standard Operating Procedures also contain instructions as to when management must be notified of non-routine operating conditions or events and to whom in management these conditions must be reported. Standard Operating Procedures include such activities as:

- Horiba Water Quality Meter Calibration, Operation, and Maintenance
- IEMP Surface Water Sampling
- NPDES Sampling

- Daily Operations at the Parshall Flume
- Enhanced Permanent Leachate Transmission System Operation
- CAWWT System Operations
- · Recovery Well Field
- DPD Method for Free and Total Chlorrine Test
- Soluble Uranium by Kenetic Phosphorescence Analyzer (KPA)
- Standing Orders for AWWT Operations

6.1.2.3 Conduct of Operations

The DOE Conduct of Operations standards are implemented for operations and maintenance through Standing Orders. The Standing Orders spell out the specific methods used by the project for the implementation of all 18 chapters of DOE Order 5480.19 (DOE 2001a). The chapter titles (which are indicative of the important operational protocol) are Operations, Organization, and Administration; Shift Routines and Operating Practices; Control Area Activities; Communications; Control of On-Shift Training; Investigation of Abnormal Events; Notifications; Control of Equipment and System Status; Lockouts and Tagouts; Independent Verification; Log Keeping; Operations Turnover; Operations Aspects of Facility Chemistry and Unique Processes; Required Reading; Timely Orders to Operators; Operations Procedures; Operator Aid Postings and Equipment; and Piping Labeling. Implementation of the Standing Orders helps to assure clarity, consistency, and a common purpose in the day-to-day activities.

6.1.2.4 Training

A training and qualification program exists to ensure that all operating personnel involved in treating wastewater are qualified and competent for their positions. The goal of the training and qualification program is to prepare personnel for the operations team and to continually improve the team's knowledge and capabilities.

6.2 <u>RESTORATION WELL PERFORMANCE MONITORING AND MAINTENANCE</u>

This section describes the key performance monitoring and maintenance guidelines for the groundwater restoration well systems. To complete the aquifer restoration within the model-predicted time frames, a high level of on-stream time at the modeled pumping rates is needed for each individual well. Actual target pumping rates are targeted at around 110% of the modeled target pumping rates to provide for downtime. Some well downtime is expected and can be accommodated. However, lengthy outages can adversely impact the planned goals. An upgraded well maintenance program has been developed to

1 ~

address this issue. More frequent component preventive maintenance checks along with periodic formal performance testing and well chlorination were identified and included as major program elements to improve well operating efficiency.

6.2.1 Restoration Well Descriptions

This section provides a general description of the extraction wells comprising the active groundwater restoration modules. The active modules are the South Plume, South Field, and the Waste Storage Area.

South Plume Extraction Wells

The South Plume Module includes six wells that are used to pump groundwater from the off-property portion of the Great Miami Aquifer plume to the Fernald site's South Field valve house. In the valve house, the flow from the south plume is routed to treatment or to the Great Miami River as necessary, to maintain compliance with discharge limitations. These wells are as follows:

Extraction Well ID	Common Well ID	Formal Site Well ID
Extraction Well 1	RW-1	3924
Extraction Well 2	RW-2	3925
Extraction Well 3	RW-3	3926
Extraction Well 4	RW-4	3927
Extraction Well 6	RW-6	32308
Extraction Well 7	RW-7	32309

Each of the South Plume extraction wells contains a submersible pump/motor assembly and has a pitless type adapter near the ground surface that transitions the vertical pump discharge piping to the underground force main. The underground force main from wells RW-1, RW-2, RW-3, and RW-4 passes through individual underground valve pits. These valve pits contain several components of the individual wells control system. RW-6 and RW-7 do not utilize underground valve pits to contain any control system components. All control components for these two wells are located in the South Plume Valve House building.

The design of the flow control systems for each of these six wells is identical; flow is controlled by a flow control loop consisting of a magnetic flow meter, a process control station (PCS), and a motor operated flow control valve. Each well can be controlled locally by the PCS or remotely by the computerized control system located at CAWWT. The normal operational mode is to have the wells operated remotely from the CAWWT computer control system, via the local PCS. Additionally, a local

set point is input to the PCS so that the well can automatically revert to local control if communication with the CAWWT computer control system is interrupted.

The desired flow rate set point for each is entered into the computer control system and PCS at the CAWWT and the South Plume Valve House respectively. This value is compared continuously to the actual flow measured by the magnetic flow meter. When required, the CAWWT computer control system or PCS adjusts the position of the flow control valve to maintain the desired flow. Pump "Start" and "Stop" can be controlled by the HMI or the PCS and can also be controlled from the pump starter panel. The starter panels for RW-1 through RW-4 are located at the individual wellheads while the starter panels for RW-6 and RW-7 are located in the South Plume Valve House.

In addition, each of the South Plume extraction wells is equipped with isolation valves; check valves, air releases and pressure indicating transmitters. The pressure indicating transmitters are tied to process interlocks that will shut the pumps down if high or low pressures are maintained for extended periods indicating a closed valve or catastrophic system leak, respectively. This interlock is intended to protect the pump/motor assemblies from damage due to closed discharge valves or to shut down the pumps if no system backpressure is sensed. Critical control components are protected by lightning/surge arresters to prevent damage to the control system during electrical storms.

Routine water level monitoring within the well is performed during regularly scheduled performance monitoring and more frequently if required.

Installation details of the South Plume extraction wells are shown in Figure 6-1.

South Field and Waste Storage Area Extraction Wells

The South Field and Waste Storage Area (WSA) Modules include thirteen and four wells, respectively, that are used to pump groundwater from the Great Miami Aquifer to the Fernald Site water treatment facilities or to the Great Miami River if treatment is not required to achieve discharge limitations. These wells are as follows:

Extraction Well ID	Common Well ID	Formal Site Well ID
Extraction Well 15A	EW-15A	33262
Extraction Well 17A	EW-17A	31567
Extraction Well 18	EW-18	31550
Extraction Well 19	EW-19	31560
Extraction Well 20	EW-20	31561
Extraction Well 21A	EW-21A	31562
Extraction Well 22	EW-22	32276
Extraction Well 23	EW-23	32447
Extraction Well 24	EW-24	32446
Extraction Well 25	EW-25	33061
Extraction Well 30	EW-30	33264
Extraction Well 31	EW-31	33265
Extraction Well 32	EW-32	33266
WSA Well 26	EW-26	32761
WSA Well 27	EW-27	33062
WSA Well 28A	EW-28A	33334
WSA Well 33	EW-33	33330

Each of the thirteen South Field and four Waste Storage Area extraction wells is of similar design with the exception of the well depth, screen length, and screen slot size. Each contains a submersible pump/motor assembly. Groundwater is pumped from the below grade pump to the wellhead at the ground surface via the vertical discharge piping. At the wellhead, this piping is routed horizontally through a magnetic flow meter and into the individual well houses. All of the individual well control components are located at these well houses.

The flow control system for each of the seventeen extraction wells is identical; flow is controlled by a flow control loop consisting of a magnetic flow meter, a process control station (PCS) and a variable frequency drive (VFD). Each extraction well can be controlled locally by the PCS or remotely by the computerized control system located at CAWWT (HMI). The normal operational mode is to have the wells operated remotely from the CAWWT computer control system, via the local PCS. Additionally, a local set point is input to the PCS so that the well can automatically revert to local control if communication with the CAWWT computer control is interrupted.

The desired flow rate set point for each extraction well is entered into the HMI and PCS at the CAWWT and the individual well houses, respectively. This value is compared continuously to the actual flow rate

measured by the magnetic flow meter. When required, the CAWWT HMI or PCS adjusts the pump motor speed via the VFD to maintain the desired flow. Pump "Start" and "Stop" can be controlled by the CAWWT HMI or the PCS and can also be controlled at the VFD.

In addition, each extraction well is equipped with isolation valves, a check valve, air releases, and a pressure-indicating transmitter. Routine water level monitoring within the well is performed during regularly scheduled performance monitoring and more frequently if required.

Installation details of the South Field Extraction Wells and Waste Storage Area Wells are shown in Figure 6-2.

6.2.2 Factors Affecting System Operation

The original 5 extraction wells comprising the South Plume groundwater restoration module began operating in August 1993, as part of the Operable Unit 5 South Plume Removal Action. In the intervening time period, valuable operational experience and knowledge has been gained that is being used to optimize long-term operation of extraction wells site wide. This experience base has resulted in identification of factors affecting operation life and efficiency, some of which were unknown at the start of pumping operations. These factors have either already been addressed or are incorporated into planned maintenance.

In order to better understand the factors affecting large-scale groundwater pumping operations, Moody's of Dayton, a water well maintenance and installation contractor, was consulted. Moody's has served the water well industry throughout the Great Miami Aquifer for more than 30 years and has extensive experience maintaining large-capacity wells for a number of major water supply systems. Frequencies for routine maintenance and monitoring activities were selected using input received from their evaluation of the South Plume Extraction well system and based on their experience working with systems of similar magnitude in the regional aquifer.

Several factors affect the performance of the extraction wells. In addition, a number of other specific requirements of the Fernald Site's system complicate these factors. All of these factors and requirements were considered in developing this plan. First, all the Fernald Site's extraction wells are placed in and are extracting water from the upper most portions of the Great Miami Aquifer. This fact complicates both pump/motor cooling and iron fouling of the extraction well screen. Normal water well practice would place the screened section of the well deeply in the aquifer and the pump/motor assembly would

be placed above the screen in a submerged section of blank casing. Since the extraction wells are intended to intercept a plume of contamination located near the top of the aquifer, the screened sections begin near the normal water level. In order to provide the required submergence of the pump/motor assembly, this assembly must be placed within the screened section. The high flow rates required for plume capture combined with the "surgical" removal of the contamination plume have led to difficulties in ensuring that the flow of water passing the motor is adequate for cooling.

Placement of the pump/motor assembly within a screen that is located on the surface of the aquifer also complicates the impacts of iron-fouling. Moody's has confirmed that iron fouling is prevalent throughout the regional aquifer and that the details of the Fernald Site installation further enhance the problem. Combined with the fact that this region of the Great Miami Aquifer contains some of the highest concentrations of iron and iron-fouling bacteria, fouling of the well screens and other downstream equipment has been experienced.

Continuous operation of the extraction wells also exacerbates the factors noted above. Normal water well industry practice does not require pumping wells to operate continuously. Typical water supply well systems pump between 6 and 10 hours per day and have spare wells that can be rotated in and out as demand requires (especially when maintenance is required). The Fernald Site's extraction well system however, runs continuously and has no spare wells to compensate for wells taken out of service for maintenance. In fact, when a well is shut down for an extended period to perform maintenance, the remaining wells may need to increase their flow to continue the planned capture of the plume.

6.2.3 MAINTENANCE AND OPERATIONAL MONITORING

Several routine activities are performed to optimize performance of the extraction wells comprising the South Plume, South Field, and Waste Storage Area groundwater restoration modules. The following maintenance and operational monitoring activities are described in this section:

- Routine system maintenance, which includes maintenance actions related to valves, instrumentation, and controls associated with each extraction well, and;
- Operational monitoring, which includes quarterly monitoring of extraction well capacity and pump/motor assembly performance.

Table 6-1 lists planned outages for the South Plume Module Wells, and Table 6-2 lists planned outages for the South Field and Waste Storage Area Wells. Routine well/screen maintenance (i.e., superchlorination) is no longer an activity of the OMMP. Advice from the site water well drilling and maintenance subcontractor coupled with lessons learned by operating extraction wells at the Fernald site for over 13 years indicate that the superchlorination procedure is not effective and that full well rehabilitations are the best approach.

Maintenance of the Pumps, Piping, and Controls

These maintenance activities are directed primarily at the valves, instrumentation, and controls associated with each extraction well. These actions will be incorporated into the Fernald Site computerized maintenance system. This system provides automatic generation of preventative maintenance work orders to ensure that routine maintenance is performed when required. In addition to formal preventative maintenance activities, several routine system checks are performed by operations personnel, between scheduled preventative maintenance activities, to ensure that equipment is functioning properly.

The following is a list of preventative maintenance and operational checks that are routinely performed:

Process Control Station: Annual

The process control stations for each of the recovery and extractions wells are taken out of service annually. At this time, the operational setup parameters for the specific wells are verified and/or updated to reflect current operating conditions. This is anticipated to require an outage of four hours per well.

Flow Meters: Clean and Calibrate Semi-Annually.

Cleaning and calibration of the flow meter is anticipated to require an outage of 4 hours per extraction well in the South Plume and 8 hours per extraction well in the South Field.

Check Valves: Inspect and Clean Seat Semi-Annually

Inspection and cleaning of the check valve is anticipated to require an outage of 4 hours per extraction well.

The piping configuration for extraction wells RW-1 through RW-4 includes two check valves. The original check valve cannot be inspected or maintained without removal from the piping system and, because of its location at the extreme end of the piping run in the valve pit, requires that the entire

South Plume extraction well system be shut down and drained. The redundant check valve was installed between isolation valves and is a "swing-check" valve that is equipped with a removable inspection plate. Inspection and cleaning of this check valve requires that the individual extraction well be shut down for approximately four hours. Extraction wells RW-6 and RW-7 and all of the South Field Extraction wells have a single in line check valve that is removed, inspected and cleaned. This maintenance activity is anticipated to require each well to be shutdown for approximately 4 hours.

Flow Control Valves and Actuators: Disassemble and inspect annually

Extraction wells RW-1 through RW-4, RW-6 and RW-7 each utilize motor operated flow control valves. These are required to be inspected and cleaned annually to prevent the buildup of iron fouling bacteria encrustation. This maintenance activity will require each well to be shut down for approximately 8 hours.

Pressure Indicating Transmitters: Annual Calibration

Each extraction well has pressure indicating transmitters that are used in performance testing to determine the pump's discharge head (pressure). Accurate pressure sensing in the full range of pumping pressures is required for accurate testing. Annual testing and calibration of these transmitters is anticipated to require an outage of 2 hours per well.

Operational Monitoring

The main system performance indicators for the South Plume and South Field extraction well modules are gathered and summarized in performance tests conducted quarterly. These tests monitor the specific capacity of each recovery/extraction well and the pump/motor assembly performance. The test results will be used to determine the need for well cleaning/redevelopment or pump/motor rebuilding. The information will help minimize unscheduled, unplanned emergency maintenance and will shorten the duration of well outages. Several of the parameters measured may be monitored more frequently to develop additional system data for trending purposes.

Parameters to Be Monitored

Extraction well operating parameters that are required to be routinely monitored include the following:

- Water level static and pumping
- Flow
- Discharge pressure
- Motor amperage draw.

Water Level Monitoring:

Water level, both static and pumping, is perhaps the most critical parameter measured and therefore needs to be measured routinely. The drawdown from static water level to the pumping water level is used to calculate a specific capacity for the well and is a direct indication of the degree of fouling of the well screen and/or the adjacent formation. The installation depth of the extraction well pump/motor assemblies has been established, based upon an anticipated worst-case drawdown of 10 feet below the seasonal low-static water levels. Historical data were reviewed to determine seasonal lows. While each setting has some added submergence to be conservative, pumping levels are monitored routinely to ensure that adequate pump/motor submergence is maintained and to prevent severe component damage.

If the pumping water level measured during the quarterly performance testing approaches the top of the pump's bowl assembly, rehabilitation efforts may be necessary. Rehabilitation efforts include cleaning of the well utilizing dual swab and airlift pumping to remove debris. After cleaning, the well will be acid treated to break down encrustation on the well screen and within the local formation. This will then be followed by chlorination to inhibit future iron-fouling bacterial growth. These processes may, if necessary, be repeated several times to ensure that the well has been rehabilitated to its optimal condition.

Flow Monitoring:

The ability of an extraction well pump/motor to sustain the desired flow is a key indicator of the health of the flow meter, controls, variable frequency drive, well and the pump/motor assembly. Specific testing to determine the ability of a pump/motor assembly to perform as expected will be completed quarterly. Additionally, individual extraction well flow is monitored continuously by the flow controller for each well. The actual flow verses the controller set point is checked by operations personnel locally, in the field once per day. Any significant deviation from the flow set point is investigated and required maintenance actions are determined then carried out.

Discharge Pressure Monitoring:

Pump discharge pressure, coupled with flow, is monitored quarterly to assess the pump/motor assemblies performance against the manufacturers published performance.

Amperage:

As with flow and pressure, amperage is a good indicator of how the pump/motor assembly is performing. During performance testing, motor amperage draw is measured on each of the three phases of the electrical supply. Amperage draw is compared to the motor manufacturer' published specifications. Amperage should be below the manufacturer's full-load amperage and should be approximately equal across the phases of the motor. An imbalance of greater than 20 percent across the phases indicates a motor or electrical supply situation that triggers more extensive diagnosis. Additional diagnostics and repairs are not within the scope of this plan.

Performance Testing

Performance testing of the extraction wells is conducted quarterly to assess their condition; this testing requires an outage of approximately 4 hours per well. Performance testing is currently performed by Moody's of Dayton, the site's drilling and well maintenance subcontractor, and is summarized in written reports. Static water-level measurements are made prior to each performance test. This measurement serves as the basis for computing drawdown within the extraction well. System flow, discharge pressure, pumping level, and motor amperage per phase are measured at each of at least five different flows for the extraction well. These five flows include maximum flow (discharge valve fully open) and zero flow conditions (discharge valve closed).

The results of these measurements are used to determine the condition of the pump/motor and of the well. Results are summarized in two ways. First, the flow and discharge head is plotted and compared to extraction well pump manufacturer and previously developed head/flow curves. Second, the static water level and pumping levels are used to calculate drawdown and specific capacity within the extraction well at various flows. As plugging of the well screen due to iron fouling and encrustation progresses, it is expected that drawdown within the well will increase for a given flow rate. If the drawdown becomes excessive, well rehabilitation efforts will likely be required.

The static water level and pumping levels will be used to calculate drawdown and specific capacity (flow rate divided by drawdown) within the recovery/extraction well at various flows. As fouling and encrustation of the well progresses, drawdown within the well will increase for a given flow rate (the specific capacity will decrease). The need for well screen maintenance activities will be triggered by excessive drawdown. Maintenance work will be planned, scheduled, and performed to avoid costly damage to equipment such as well pump/motor assembly and to avoid lengthy outages. Additionally, the amperage draw of the well at various flows is compared to previous readings and

pump/motor manufacturers published information.

6.3 TREATMENT FACILITIES PERFORMANCE MONITORING AND MAINTENANCE

This section describes the key performance monitoring parameters and maintenance needs for the wastewater treatment systems and their ancillary facilities. Meeting the Fernald site effluent discharge uranium limit of 30 ppb on a monthly average basis within the accelerated schedule is an ambitious undertaking. The experience that has been gained in operating the various Fernald site systems provides an increased confidence level that the limit may routinely be met.

6.3.1 Treatment Facilities Performance Monitoring

CAWWT uses strong base-anion exchange as the final unit process for uranium removal. The strong base-anion exchange resins have a very strong affinity for the uranyl carbonates in the Fernald site's wastewater. The technology is reliable; however, treatment to the effluent levels required at the Fernald site (i.e., <30 ppb) is not widely practiced in wastewater systems. An expected performance of the CAWWT system has been used in this plan to demonstrate the ability to meet the Record of Decision effluent requirements. The performance expectations are, for the most part, based on historical Fernald site operating experience, utilizing new resin, as opposed to vendor performance guarantees or widely published data.

Measurable parameters for the CAWWT treatment system are the total volume of water treated, the influent and effluent uranium concentrations and mass, and the total mass of uranium removed by treatment. The Fernald site total effluent flow rate is metered. Flow weighted composite samples of the effluent are analyzed daily for total uranium. Those two parameters are used to measure compliance with the Operable Unit 5 Record of Decision requirements for uranium discharge in the Fernald site's effluent. Additionally, each individual CAWWT treatment train has flow measurement and control. The individual treatment systems are also routinely sampled at strategic process locations, including the inlet and outlet of each ion exchange vessel. The sample results and treatment flow rates are reported, tracked, and used to determine the need for troubleshooting, process adjustments, and corrective actions. All of the routine uranium analytical work is conducted in a laboratory located within the CAWWT, Building 51A.

6.3.2 Treatment Facilities Maintenance Practices

The CAWWT system is designed with only two ion exchange units per train. Normally, both units in a train operate in series. For short-duration shutdowns of a single vessel (e.g., backwashing, minor maintenance, etc.), flow will be routed through one ion exchange unit only. Long-duration outages of a single vessel may necessitate specific well shutdowns, depending on the overall system performance and on the performance of the affected train. The two-vessel-per-train configuration was selected during the project's design to provide a higher total system capacity and better equipment utilization within the remaining serviceable space in Building 51.

As described above, much of the routine preventive maintenance and repair work in the treatment systems can be accomplished without a unit shutdown, because of the installed spare equipment and bypass piping and valving. There are some planned maintenance activities that will result in treatment system outages. The Operable Unit 5 Record of Decision provides for relief allowances from the effluent discharge limit of a monthly average of 30 ppb uranium concentration during periods of treatment plant scheduled maintenance. Decisions regarding well operations during treatment plant scheduled maintenance will be made on a case-by-case basis. For planned maintenance shutdowns, advanced EPA approval will be obtained for relief allowances that may be requested.

Some breakdowns will lead to system shutdowns. Loss of utilities or a failure in the CAWWT's computerized control system would result in a system shutdown. All treatment systems will fail safely on loss of a utility or a major component and are not very complicated to restart.

6.4 REGULATORY ISSUES

Current extraction well rehabilitation efforts require the addition of chemicals to the well. Well rehabilitation efforts require the use of both sodium hypochlorite and hydrochloric acid. The hydrochloric acid is used to break down flow-limiting encrustation on the well screen. The sodium hypochlorite is used to disinfect the well and inhibit the growth of iron fouling bacteria. The sodium hypochlorite and hydrochloric acid are purged from the well by pumping to a tanker truck and discharging the dilute chemicals for subsequent treatment at CAWWT and discharge to the Great Miami River via the Parshall Flume.

The use of these chemicals in well rehabilitation efforts to date has been monitored closely. Ohio EPA has been notified and has approved of the intended chemical additions and subsequent discharges. After the addition of these chemicals, the water pumped initially from the extraction well is turbid, contains iron residual, dissolved scale, and has a low pH.

Adequate dilution of this stream in the CAWWT Backwash Basin is anticipated so that chlorine, turbidity, and low pH will not exceed National Pollutant Discharge Elimination System (NPDES) outfall limits. The chlorine residual is expected to fall to acceptable limits prior to pumping.

In order to discharge chlorinated water, the amount of chlorine residual and rate of discharge must not produce a detectable level (currently defined by OEPA as 0.038 mg/L) of residual chlorine at the Parshall Flume (NPDES Outfall 4001).

TABLE 6-1
PLANNED OUTAGES OF THE SOUTH PLUME MODULE WELLS


ltem	Description	Frequency	Duration per Even
1	Performance Testing	Quarterly	4 hours/well
2	Process Control Station	Annually	4 hours/well
3	Pressure Transmitter Calibration	Annually	2 hours/well
4	Magnetic Flow Meter Clean and Calibrate ^a	Semi-Annually	4 hours/well
5	Check Valve Inspect/Clean	Semi-Annually	4 hours/well
6	Flow Control Valve and Actuator Cleaning	Annually	8 hours/well
7	Rehabilitation	Variable	3 weeks


^aFlow meter calibration may occur as a post maintenance test utilizing a portable flow meter.

TABLE 6-2
PLANNED OUTAGES OF THE SOUTH FIELD AND WASTE STORAGE AREA MODULE WELLS

Item	Description	Frequency	Duration per Even
1	Performance Testing	Quarterly	4 hours/well
2	Process Control Station	Annually	4 hours/well
3	Pressure Transmitter Calibration	Annually	2 hours/well
4	Magnetic Flow Meter Clean and Calibrate ^a	Semi-Annually b	8 hours/well
5	Check Valve Inspect/Clean	Semi-Annually	4 hours/well
6	Rehabilitation	Variable	3 weeks

^aFlow meter calibration may occur as a post maintenance test utilizing a portable flow meter.

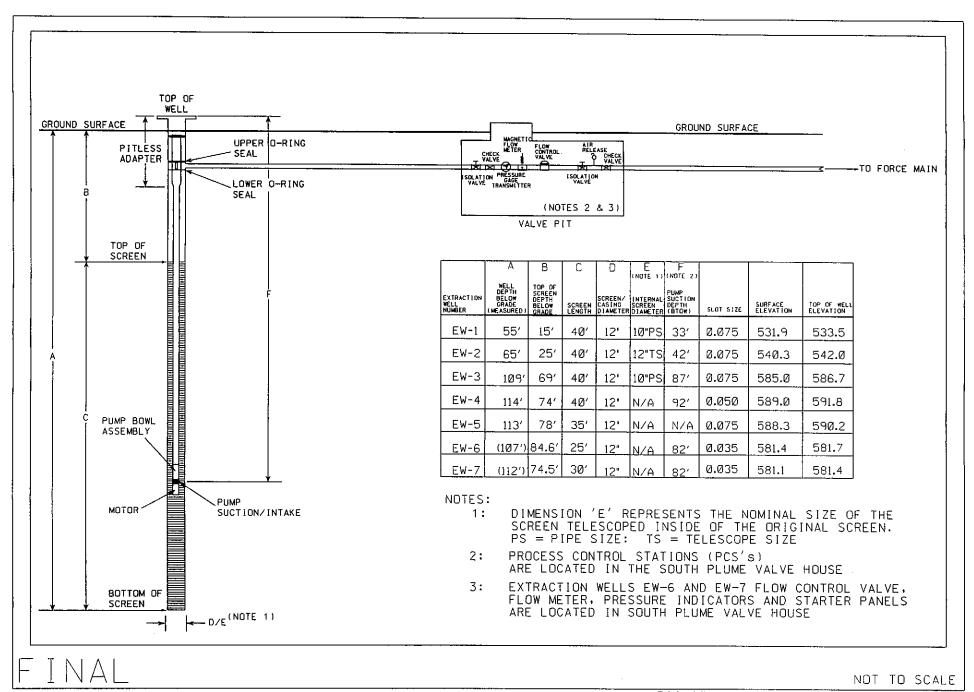

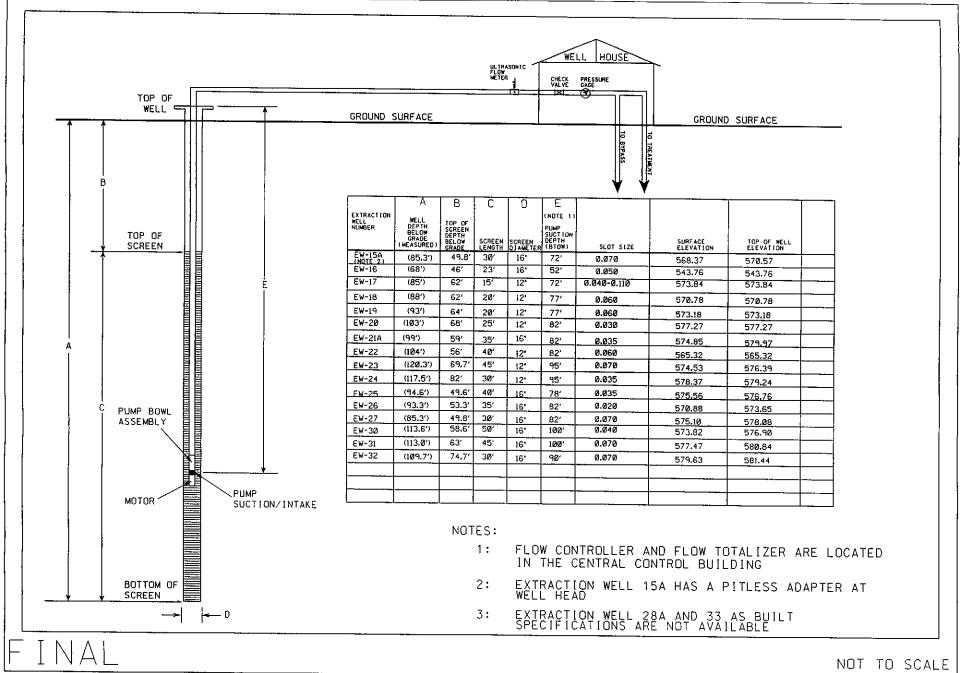

V:/5FGP1/DGN/DMMP/2006-DMMP/06-DMMP-3.DGN

23-JUN-2006

FIGURE 6-2. SOUTH FIELD MODULE AND WASTE STORAGE, AREA EXTRACTION WELL INSTALLATION DETAILS

7.0 ORGANIZATIONAL ROLES, RESPONSIBILITIES, AND COMMUNICATIONS

This section presents the organizational roles and responsibilities with respect to implementation of this OMMP. Also presented are information needs and communications protocol for coordination with other Fernald site project organizations, and interaction with the EPA and OEPA.

7.1 ORGANIZATION ROLES AND RESPONSIBILITIES

7.1.1 DOE-LM Fernald

The DOE is responsible for providing direction and oversight of all activities at the Fernald site.

7.1.2 Operating Contractor

S. M. Stoller, is the Legacy Management contractor for the Fernald site. The OMMP falls under the responsibility of the Site's ARWWT Project.

The ARWWT Project is responsible for all engineering design and construction activities for the OMMP which include:

- Engineering functional requirements, design basis, and detailed design drawings and documents
- Title III engineering support during construction
- Start-up Plans, System Operability Test procedures, and test supervision
- Standard Start-up Review Plans and coordinating resolution of operational issues
- Technical support of well field and water treatment operations
- Coordination of project-specific activities associated with procurement and management of construction contractors.

The ARWWT project is also responsible for all aquifer restoration planning and environmental monitoring/reporting activities within the project, which include:

- Developing and maintaining the aquifer restoration strategy
- Developing and implementing remedy performance groundwater monitoring, data evaluation, and reporting
- Technical input to operations on recovery well operation and maintenance
- Technical input to operations regarding compliance with discharge limits
- Technical input to design and construction of site groundwater extraction/injection systems
- Preparation of required CERCLA documentation (e.g., RA Work Plan, aquifer remedy design documents, the IEMP groundwater section, and various other required reports).

The ARWWT team is also responsible for all operations and maintenance activities within the project, which include:

- Operations of groundwater extraction and injection well systems
- Operation of all site wastewater treatment systems and their ancillary facilities
- Estimate, plan, and execute corrective and preventative maintenance
- Training and qualification of operators and supervisors
- Develop, review and revise Standard Operating Procedures
- Sampling and analysis of process streams for compliance with operational parameters and established regulatory limits.

Site Environmental Compliance personnel are responsible for:

- Fulfilling site NPDES reporting requirements
- Analysis of state and federal regulations to identify project-specific regulatory requirements

The site Safety and Health team in conjunction S.M. Stoller corporate safety personnel are responsible for the following Safety and Health activities within the project:

- Development and revision of Safety and Health Project matrices for operations and construction
- Radiological monitoring of activities
- Industrial health monitoring of activities
- Oversight of construction and operations safety programs
- Safety design reviews and technical input.

Individual project team members are responsible for the safe execution of the work assigned to them and have the right to stop work if unsafe conditions are observed.

The S. M. Stoller site Project Controls personnel in conjunction with the ARWWT Project manager are responsible for:

- Project cost and schedule baseline development and maintenance
- Cost performance and variance reporting to DOE
- Estimate at completion funding analysis and reporting
- Change proposal and cost savings coordination
- Project quality assurance oversight.

7.2 REGULATORY AGENCY INTERACTION

Interaction with EPA and OEPA regarding the OMMP initially occurs during the review and comment resolution process for the document. Future versions of the OMMP will also be submitted for review and will go through a review and comment resolution process similar to this submittal. As noted in Sections 1.0 and 3.0, the IEMP provides for the collection and reporting of groundwater remedy performance (IEMP Section 3.0) and treated effluent (IEMP Section 4.0) information that supports operational decisions regarding groundwater restoration and water treatment.

The current plan is that well field and treatment operational summaries are included in the IEMP reporting process. These summaries allow for agency input as aquifer restoration and water treatment progress. In addition, the NPDES and FFCA reporting will continue as outlined in Section 4.0 of the IEMP. The ARWWT participation in meetings and weekly conference calls will continue as necessary.

REFERENCES

- Fluor Fernald, Inc., 2003, "Comprehensive Groundwater Strategy Report," Final, Revision 0, Fernald Closure Project, U.S. Dept. of Energy, Fernald Closure Project, Fernald Area Office, Cincinnati, OH, June 2004.
- U.S. Department of Energy (DOE), 2006a, "Legacy Management Fernald Operating Procedures," Revision 0, S.M. Stoller Corporation, Grand Junction, CO
- U.S. Department of Energy (DOE), 2006b, "Integrated Environmental Monitoring Plan," 2505-WP-0022, Revision 5A, Draft Final, Fernald Closure Project, Cincinnati, OH, June.
- U.S. Department of Energy (DOE), 2006c, "Fernald Groundwater Certification Plan," 51900-PL-0002, Revision 1, Fernald Closure Project, Cincinnati, OH, April.
- U.S. Department of Energy (DOE), 2005, "Waste Storage Area (Phase II) Design Report," 52424-RP-0004, Revision A, Draft Final, Fernald Closure Project, Cincinnati, OH, June.
- U.S. Department of Energy (DOE), 2001a, "Design for the Remediation of the Great Miami Aquifer in the Waste Storage and Plant 6 Areas," Revision A, Draft Final, Cincinnati, OH, April.
- U.S. Department of Energy (DOE), 2001b, "Conduct of Operations Standards," DOE Order 5480.19, Change 2, Washington, D.C., October 23.
- U.S. Department of Energy (DOE), 1997a, "Baseline Remedial Strategy Report, Remedial Design for Aquifer Restoration," 2505-RP-0003, Revision 0, Final, Fernald Environmental Management Project, Cincinnati, OH.
- U.S. Department of Energy (DOE), 1997b, "Remedial Action Work Plan for Aquifer Restoration at Operable Unit 5," 2505-WP-0030, Revision 0, Final, Fernald Environmental Management Project, Cincinnati, OH.
- U.S. Department of Energy (DOE), 1996a, "Remedial Design Work Plan for Remedial Actions at Operable Unit 5," Final, Fernald Environmental Management Project, Cincinnati, OH, August.
- U.S. Department of Energy (DOE), 1996b, "Record of Decision for Remedial Actions at Operable Unit 5," Final, Fernald Environmental Management Project, Cincinnati, OH, January.
- U.S. Department of Energy (DOE), 1995a, "Feasibility Study Report for Operable Unit 5," Final, Fernald Environmental Management Project, Cincinnati, OH, June.
- U.S. Department of Energy (DOE), 1995b, "Remedial Investigation Report for Operable Unit 5," Final, Fernald Environmental Management Project, Cincinnati, OH, March.